# CMV

# Vertical, multistage centrifugal pumps 50 Hz





**BE THINK INNOVATE** 

(	റ	
9	0	
	2	
(	Ð	
	2	
(	S	

1.	General description	<b>3</b> 3
2.	Overview	4
3.	Applications	5
4.	Features and benefits	7
5.	Identification Type key	<b>8</b> 8
6.	Product range	9
7.	<b>Performance range</b> CMV, 50 Hz	<b>10</b> 10
8.	Operating conditions Environmental rating	<b>11</b> 11
9.	Pumped liquids List of pumped liquids	<b>13</b> 13
10.	<b>Construction</b> Pump Motor Frequency converter operation Shaft seal Material specification	<b>16</b> 16 16 16 17 19
11.	Grundfos CUE CMV pumps connected to Grundfos CUE frequer converters	<b>20</b> ncy 20
12.	Approvals and markings Approvals Markings	<b>21</b> 21 21
13.	Certificates	22
14.	Selection and sizing Selection of pumps	<b>24</b> 24
15.	How to read the curve charts Guidelines to performance curves	<b>26</b> 26
16.	Performance curves, CMV, 50 Hz CMV 3 CMV 5	<b>27</b> 27 28
17.	Dimensions, CMV 50 Hz CMV 3 CMV 5	<b>29</b> 29 30
18.	Weights and shipping volumes	31
19.		32
<u>.</u>	Mains-operated motors, 50 Hz	32
20.	Customisation Motors	<b>33</b> 33
	Pumps	36

21.	Accessories	37
	Pipework connections	37
	MP 204 motor protector	40
	Cover for CMV motor	40
	Angled cable gland	40
22.	Further product documentation	41
	WebCAPS	41
	WinCAPS	42

# 1. General description

# Introduction

The Grundfos CMV pumps are non-self-priming, vertical, multistage centrifugal pumps. The pumps are of the close-coupled type. CMV pumps are fitted with mechanical shaft seals.

The CMV pumps are available in cast iron (EN-GJL-200).

- The impeller and chamber are made of stainless steel (EN 1.4301/AISI 304).
- The drain and filling plugs are made of stainless steel (EN 1.4404/AISI 316L).
- The pump shaft is made of stainless steel (EN 1.4057/AISI 431).



Fig. 1 Grundfos CMV pumps

The CMV pumps are unique products that have been developed in order to fulfil a wide variety of customer demands.

The CMV pumps are available in various sizes and numbers of stages to provide the flow and pressure required.

The CMV pumps consist of two main components: the motor and the pump unit.

The motor is a Grundfos motor designed to EN standards.

The pump unit incorporates optimised hydraulics and offers various types of connections.

The pumps offer many advantages, some of which are listed below and described in detail in *4. Features and benefits* on page 7:

- compact design
- worldwide usage
- high reliability
- service-friendly
- wide performance range
- low noise
- customised solutions.

# 2. Overview



Applications



Pages 5 and 6

Identification



Page 8

Operating conditions






connections

Pipe

# Performance curves

Pages 11 and 12



Pages 27 and 28

Further product information



Pages 41 and 42

Construction



Pages 16 to 19

Dimensions

Pages 29 and 30

GRUNDFOS X

Certificates and approvals



Pages 22 and 23

Motor data

Pages 32



sizing

Selection and







Customisation



Page 33 to 36







# 3. Applications

The CMV pumps are designed to cover a wide variety of applications, ranging from small domestic installations to small industrial systems. The pumps are therefore suitable for a wide diversity of pumping systems where the performance and material of the pump must meet specific demands.

Some of the most typical applications are mentioned below:

- · washing and cleaning
- pressure boosting
- temperature control.

# Washing and cleaning



Fig. 2 Washing and cleaning

CMV pumps can be used in washing and cleaning applications, which usually involve pumping of water containing soap or other cleaning agents.

### **Reference applications**

Typical washing and cleaning applications:

- degreasing and washing of production equipment in industrial environments such as the food and beverage industry
- washing machines
- · vehicle-washing tunnels
- · mobile-washing units
- units for CIP (Cleaning In Place).

## **Pressure boosting**



#### Fig. 3 Pressure boosting


In pressure-boosting applications, the pumped liquid must be delivered at a desired pressure on demand. The main priorities in pressure-boosting applications are to ensure maximum reliability and user comfort. Therefore, the CMV pumps are also ideal for such applications.

#### **Reference applications**

Typical pressure-boosting applications:

- · pressure boosting and transfer of drinking water
- process-water systems.

## **Temperature control**



GrA6288

Fig. 4 Temperature control

Temperature control involves applications where the CMV pumps circulate a liquid in a closed loop consisting of a heating or cooling element for optimising a process by means of temperature. Temperature control is also chilling of equipment or food and beverage in the food production industry.

### **Reference applications**

The CMV pumps can for example be used in temperature control systems such as:

- · electronic data processing
- · laser equipment
- medical equipment
- industrial refrigeration
- heating and cooling in industrial processes
- moisturising and humidifying.

To ensure safe and reliable operation in applications involving temperature control, we offer CMV pumps designed to meet your requirements!

We provide solutions for applications involving pumping of these liquids:

- liquids at temperatures down to -20 °C
- high-temperature liquids
- high-viscous liquids, etc.

### Pumping of liquids at temperatures down to -20 °C\*

When pumping liquids at temperatures down to -20 °C, it is crucial that the pump parts are made of the right materials and have the right dimensions. At such low temperatures, the selection of wrong materials and dimensions may cause deformation because of thermal expansion, and eventually stoppage of operation.

### Pumping of high-viscous liquids

In applications where high-viscous liquids are pumped, the motor of the pump can be overloaded, and the pump performance will be reduced.

The viscosity of a pumped liquid depends strongly on the pumped liquid and its temperature.

To meet the above-mentioned requirements, we offer CMV pumps with oversize motors.

# 4. Features and benefits



Fig. 5 CMV pumps

CMV pumps offer the following features and benefits:

# Compact design

Pump and motor are integrated in a compact and user-friendly design.

# Modular construction/customised solutions

The modular construction of the CMV pumps makes it easy to create many different variants based on standard factory parts. This means that it is possible to create pump variants that are customised for the application in question.

# Worldwide usage

- CMV pumps are as standard available with singleand three-phase motors suitable for 50 Hz voltage supplies. Other voltage and frequency combinations to cover markets worldwide are available upon request.
- Various certificates covering worldwide usage are available. See *13. Certificates* on page 22.

# High reliability

- New state-of-the-art shaft seal design and materials offering these benefits:
  - high wear resistance and long operating life
  - improved sticking and dry-running capabilities.
- The pumps are less sensitive to impurities in the pumped liquid than similar pumps of the canned-rotor type.

# Easy installation and commissioning

- A Quick Guide is supplied with each CMV pump, which enables easy installation and commissioning. Detailed multilingual installation and operating instructions are supplied with each pump.
- An installation indicator is fitted on three-phase pumps, which makes it easy to see if the electrical connection of the motor is correct. Based on the motor cooling air, it indicates the direction of rotation of the motor.



FM05 0870 1811

Fig. 6 Installation indicator

# Service-friendly

- Service was in mind during the development.
- No special service tools required.
- Spare parts in stock for quick delivery.
- All parts available as kits, single parts or bulks.
  Service instructions and video make it simple to disassemble and assemble the pump.
- Service kit instructions available where estimated necessary.

# Low noise level

FM05 0727 1511

The CMV pumps offer very silent operation.

# High-performance hydraulics

Pump efficiency is maximised by the optimised hydraulics and carefully crafted production technology.

# Electro-coated cast-iron parts

- Optimised corrosion resistance
- Better efficiency because of smooth surfaces.

# **Customised solutions**

It is possible to create many different variants of the CMV pump.

For further information, see *20. Customisation* on page 33.

- Motor adaptation.
- Pump body modifications.

### Grundfos motor

Grundfos motors are remarkably silent and highly efficient.

### Data and literature about the CMV pumps

All literature and technical data related to CMV pumps are available on line in Grundfos WebCAPS.

7

# 5. Identification

# Type key

Example CMV 3 - 8 A - R - A - E - A V	/ B E F - A - A - N - X - X
Type range	Terminal box position (degrees between inlet
CMV: Centrifugal Modular Vertical	and outlet)
	0 °
Rated flow rate	B: 90 °
Rated flow rate at 50 Hz [m <sup>3</sup> /h]	C: 180 °
	D: 240 °
Number of impellers	
	Outlet position (degrees between inlet and
Pump version	outlet)
A: Basic version	180 °
B: Oversize motor (one flange size larger)	A: 0°
E: Pumps with certificates/approvals	B: 90 ° D: 240 °
P: Undersize motor (one flange size smaller) T: Oversize motor (two flange sizes larger)	D. 240
BE: Oversize motor with certificates/approvals	Sensor
EP: Pumps with certificates/approvals and undersize	Sensor
EF. motor	Sensor designation
ET: Pumps with certificates/approvals and double-oversize motor	Mains plug
EX: Pumps with certificates/approvals and two other variants selected	A: Prepared for cable glands
X: Special pump	B: Harting <sup>®</sup> plug C: With cable
Pipe connection	D: Cable gland included
C: Tri-Clamp <sup>®</sup>	
F: DIN, JIS or ANSI flange	Motor information
P: PJE/Victaulic <sup>®</sup> coupling	A: Standard motor (IP55)
R: Whitworth thread Rp (ISO 7/1)	B: Phase-insulated motor for use with frequency converter
S: Internal NPT thread	C: Condensing environments
	D: Pt100 in stator
Materials in contact with pumped liquids	E: Angular contact bearing
Suction and discharge parts EN-GJL-200	F: Motor heater
A: Pump shaft EN 1.4057/AISI 431 Impellers/chambers EN 1.4301/AISI 304	G: Three-phase motor with overload protection H: Single-phase motor with no protection
X: Special version	J: Low-noise motor
Rubber parts in pump (excl. neck ring and shaft seal)	Supply voltage
E: EPDM (ethylene propylene)	A: 1 x 220 V, 60 Hz
V: FKM (flour)	B: 1 x 115/230 V, 60 Hz
<b>Note:</b> Gaskets between chambers are always made of Tesnit <sup>®</sup> BA-U. In pumps with 8 impellers, the 3 uppermost gaskets between the chambers	C: 1 x 220-240 V, 50 Hz D: 1 x 127 V, 60 Hz
are replaced with O-rings.	E: 3 x 208-230/440-480 V, 60 Hz
In pumps with 9 or 10 impellers, the 4 uppermost gaskets between the chambers are replaced with O-rings.	F: 3 x 220-240/380-415 V, 50 Hz
	G: 3 x 200/346 V, 50 Hz; 200-220/346-380 V, 60 Hz H: 3 x 575 V, 60 Hz
	I: 3 x 400 V, 50/60 Hz
	J: 3 x 380-415 V, 50 Hz; 440-480 V, 60 Hz
	O: 3 x 220-240/380-415 V, 50 Hz 3 x 220-255/380-440 V, 60 Hz
Shaft	
Shart	
Shaft seal type designation	Material of secondary seal
A: O-ring seal with fixed driver	E: EPDM (ethylene propylene) V: FKM (flour)
Material of rotating seal face	
Q: Silicon carbide (SIC)	Material of stationary seal face
V: Aluminium oxide (Al203)	B: Carbon, synthetic resin-impregnated
Note: The type key cannot be used for ordering as not all combinations are possible	Q: Silicon carbide (SIC)

**1** Identification

# 6. Product range

	Material	Shaft seal —				Supply voltage [V]* Mains-operated motor	
Pump type	Material				_		
	Cast iron, EN-GJL-200	AVBE	AVBV	AQQE	AQQV	1 x 220-240 V, 50 Hz (supply voltage C)	3 x 220-240 V/380-415 V, 50 Hz (supply voltage F)
CMV 3-2	•	٠	•	٠	٠	•	•
CMV 3-3	•	٠	٠	٠	•	•	•
CMV 3-4	•	٠	٠	٠	•	•	•
CMV 3-5	٠	٠	•	٠	•	•	•
CMV 3-6	•	٠	٠	٠	•	•	•
CMV 3-7	•	٠	٠	٠	•	•	•
CMV 3-8	•	٠	•	٠	•	•	•
CMV 3-9	•	٠	•	٠	٠	•	•
CMV 3-10	•	٠	•	٠	٠	•	•
CMV 5-2	•	٠	•	٠	•	•	•
CMV 5-3	•	٠	•	٠	٠	•	•
CMV 5-4	•	٠	•	٠	٠	•	•
CMV 5-5	•	٠	•	٠	•	•	•
CMV 5-6	•	٠	•	٠	•	•	•
CMV 5-7	•	٠	•	٠	•	•	•
CMV 5-8	•	٠	٠	٠	٠	٠	•
CMV 5-9	•	٠	•	٠	•	•	•
CMV 5-10	۲	•	•	•	•	•	•

\* Other supply voltages are available on request.

# 7. Performance range

# CMV, 50 Hz

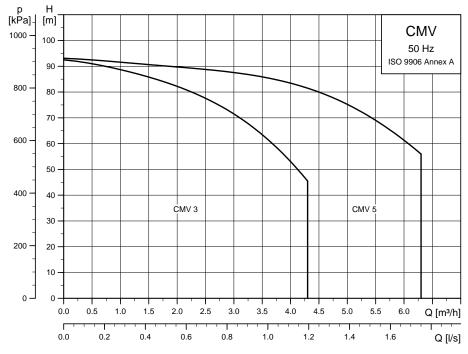


Fig. 7 Performance range

# Ambient temperature

# Maximum ambient temperature in relation to liquid temperature

The maximum ambient temperature depends on the liquid temperature as shown in the table below.

Maximum ambient temperature	Liquid temperature
+55 °C	+90 °C

#### Storage and transport temperature

-50 °C to +70 °C.

## Installation of pump

The pump must be installed with the motor shaft vertical. It must be mounted on a plane surface and secured by foundation bolts.

The pump should be installed so that the suction pipe is as short and the suction lift as small as possible.

The pump should be sited in a well ventilated but frost-free position.

The pump may be sited outdoors, but it should be protected from the elements by means of a suitable cover.

The pump should be installed with easy access for inspection, maintenance and service.

# Maximum operating pressure and permissible liquid temperature

The maximum operating pressure and the permissible liquid temperature depend on the pump material, the type of shaft seal and the pumped liquid.

Shaft seal	Permissible liquid temperature <sup>*)</sup>	Maximum operating pressure
AVBx	-20 °C to +40 °C +41 °C to +90 °C	10 bar 6 bar
AQQx	-20 °C to +90 °C	10 bar

\*) At liquid temperatures below 0 °C (32 °F), higher motor outputs may be required due to increased viscosity, for instance if glycol has been added to the water.

## **Operation in condensing environments**

If the liquid temperature becomes lower than the ambient temperature, condensation may form in the motor during inactivity. In such cases, a motor suited for condensing environments must be used.

When installing CMV pumps outdoors, provide them with a suitable cover to protect them from build-up of condensed water.

Motors in outdoor installations radiate heat to and absorb heat from their surroundings. By day, a stopped motor will absorb more heat than it radiates; by night, especially clear nights, radiation from a stopped motor may be so high that the surface temperature falls a few degrees below the air temperature. This may cause the formation of condensation. Condensation on the inner surfaces may result in moisture on the electric components, including the printed-circuit boards, which means a risk of failure or even destruction of the motor.

Furthermore, the cover protects the motor against direct sunlight.

# **Environmental rating**

All motors are IP55.

## Operating range of the shaft seal

The operating range of the shaft seal depends on operating pressure, type of shaft seal and liquid temperature.

The curve in fig. 8 shows which shaft seals are suitable at a given temperature and a given pressure.

The curve applies to clean water.




Fig. 8 Curve for the selection of shaft seals

Antifreeze should be added at liquid temperatures below 0 °C.

#### Shaft seal run-in

The seal faces of the shaft seal are lubricated by the pumped liquid which means that a certain amount of leakage from the seal can be expected.

During the initial operating hours of the pump or when a new shaft seal is installed, a certain run-in period is required before the leakage is minimised. The amount of time required depends on the operating conditions, i.e. every time the operating conditions change, a new run-in period will basically be initiated.

Under normal conditions, the leaking liquid will evaporate. As a result, no leakage will be detected. However, some liquids, such as kerosene, will not evaporate. The leak will therefore appear as a shaft seal failure. **Operating conditions** 

## Viscosity

The pumping of liquids with densities or kinematic viscosities higher than those of water will cause a considerable pressure drop, a drop in the hydraulic performance and a rise in the power consumption.

For instance at liquid temperatures below 0 °C (32 °F), higher motor outputs may be required due to increased viscosity if glycol has been added to the water.

In such situations, the pump should be fitted with a larger motor. If in doubt, contact Grundfos or visit WebCAPS. See page 41.

# Sound pressure level

The sound pressure values in the table below apply for CMV pumps. If the motor output  $(P_2)$  for a given CMV pump is not found in the table, use the nearest rounded-up value. The values for sound pressure include a tolerance of 3 dB(A) according to EN ISO 4871.

50 Hz	60 Hz
[dB(A)]	Ē <sub>pA</sub> [dB(A)]
50	55
50	53
50	54
52	57
54	59
54	59
55	60
62	66
60	65
60	65
60	65
	LpA [dB(A)]           50           50           50           50           50           52           54           55           62           60           60

The audible noise from CMV pumps is primarily noise from the motor fan.

# Minimum inlet pressure, NPSH

Calculation of the inlet pressure "H" is recommended in these situations:

- The liquid temperature is high.
- The flow is significantly higher than the rated flow.
- Water is drawn from depths.
- Water is drawn through long pipes.
- Inlet conditions are poor.

To avoid cavitation, make sure that there is a minimum pressure on the suction side of the pump. The maximum suction lift "H" in metres head can be calculated as follows:

 $H = p_b x 10.2 - NPSH - H_f - H_v - H_s$ 

p <sub>b</sub>	=	Barometric pressure in bar. (Barometric pressure can be set to 1 bar). In closed systems, p <sub>b</sub> indicates the system pressure in bar.
NPSH	=	Net Positive Suction Head in metres head. (To be read from the NPSH curve at the highest flow the pump will be delivering).
H <sub>f</sub>	=	Friction loss in suction pipe in metres head. (At the highest flow the pump will be delivering).
H <sub>v</sub>	=	Vapour pressure in metres head. (To be read from the vapour pressure scale, " $H_v$ " depends on the liquid temperature " $T_m$ ").
H <sub>s</sub>	=	Safety margin = minimum 0.5 metres head.

If the "H" calculated is positive, the pump can operate at a suction lift of maximum "H" metres head.

If the "H" calculated is negative, an inlet pressure of minimum "H" metres head is required.

**Note:** To avoid cavitation, **never** select a pump with a duty point too far to the right on the NPSH curve.

Always check the NPSH value of the pump at the highest possible flow.

# 9. Pumped liquids

Thin, non-explosive liquids, not containing solid particles or fibres. The liquid must not chemically attack the pump materials.

When pumping liquids with a density and/or viscosity higher than those of water, oversized motors must be used, if required.

Whether a pump is suitable for a particular liquid depends on a number of factors of which the most important are the chloride content, pH value, temperature and content of chemicals and oils.

Please note that aggressive liquids (for instance seawater and some acids) may attack or dissolve the protective oxide film of the stainless steel and thus cause corrosion.

# List of pumped liquids

A number of typical liquids are listed below.

Other pump versions may be applicable, but those stated in the list are considered to be the best choices.

The table is intended as a general guide only and cannot replace actual testing of the pumped liquids and pump materials under specific working conditions.

The list should, however, be applied with some caution as factors such as concentration of the pumped liquid, liquid temperature or pressure may affect the chemical resistance of a specific pump version.

Safety precautions must be taken when pumping dangerous liquids.

#### Notes

а	To minimise the risk of corrosion the pump must be running continuously, i.e. standstills must not exceed 6 to 8 hours.
b	May contain additives or impurities which can cause shaft seal problems.
с	The density and viscosity may differ from those of water. Consider this when calculating motor and pump performance.
d	In order to avoid corrosion, the liquid must be free of oxygen.
е	Flammable or combustible liquid. Safety precautions must be considered to ensure safe handling of flammable liquids. Handling the liquid above the flash point and/or boiling point will require the greatest restrictions. A seal-less pump may be required. Contact Grundfos.
f	Risk of crystallisation/precipitation on the shaft seal.
g	If oil residues are present, EPDM cannot be used.
h	As no protective deposits are formed in demineralised water, a slight increase in the corrosion rate is to be expected. If impurities (e.g. contamination with metal ions) in the pumped liquid are unacceptable, cast iron or copper containing metals should not be used. If the $CO_2$ content is high, cast iron is unsuitable for use.
i	Special conditions related to the properties of demineralised water with a conductivity less than 2 microS/cm makes a SiC/SiC shaft seal unsuitable for use. Use the ceramic/carbon shaft seal combination instead.

U
=
3
_
0
Ð
ã
~
=
<u>_</u>
=.
D
sp
0,

Pumped liquids	Chemical formula	Notes	Additional information	Cast iron (EN-GJL-200)
Water				
Boiler feed water				AVBE/AQQE
Condensate				AVBE/AQQE
Cooling and cutting lubricant		b		AQQV
Groundwater			< 300 ppm chloride	AVBE/AQQE
Demineralised water		h	> 2 microS/cm	AQQE
Demineralised water		h, i	< 2 microS/cm	AVBE
District heating water				AVBE/AQQE
Dil-containing water				AVBV/AQQV
Softened water				AVBE/AQQE
Coolants				
Ethylene glycol	C <sub>2</sub> H <sub>4</sub> (OH) <sub>2</sub>	b, c		AQQE
Glycerine (glycerol)	C <sub>3</sub> H <sub>5</sub> (OH) <sub>3</sub>	b, c		AQQE
Hydrocarbon-based coolant		c, e		AQQV
Potassium acetate (inhibited)	CH <sub>3</sub> COOK	b, c, d, f		AQQE
Potassium formate (inhibited)	HCOOK	b, c, d, f		AQQE
Propylene glycol Fuels	CH <sub>3</sub> CHOHCH <sub>2</sub> OH	b, c		AQQE
Diesel oil		e		AVBV/AQQV
Jet fuel Kerosene		e		AVBV/AQQV AVBV/AQQV
		e		AVBV/AQQV AVBV/AQQV
Naphta Petrol		e		AVBV/AQQV AVBV/AQQV
Biodiesel		e		AVBV/AQQV AVBV/AQQV
Mineral oils				THE WINGOV
Crude oil		b, c, e	< 20 °C	AQQV
Vineral lubricating oil		c, e		AVBV/AQQV
Mineral motor oil		c, e		AVBV/AQQV
Synthetic oils				
Synthetic lubricating oil		с, е		AVBV/AQQV
Synthetic motor oil		c, e		AVBV/AQQV
Silicone oil		с		AVBV/AQQV
Vegetable oils				
Corn oil		b, c		AVBV/AQQV
Olive oil		b, c		AVBV/AQQV
Peanut oil		b, c		AVBV/AQQV
Rapeseed oil		b, c		AVBV/AQQV
Soy oil		b, c		AVBV/AQQV
Cleaning				
Alkaline degreasing agent		b, g		AQQE
Soap (salts of fatty acids)		b	< 80 °C	AQQV
Organic solvents				
Acetone	C <sub>3</sub> H <sub>6</sub> O	е		AVBE/AQQE
Ethyl alcohol (ethanol)	C <sub>2</sub> H <sub>6</sub> O	е		AVBE/AQQE
Isopropyl alcohol	С <sub>3</sub> Н <sub>7</sub> ОН	е		AVBE/AQQE
Methyl alcohol (methanol)	CH <sub>3</sub> OH	е		AVBE/AQQE

Pumped liquids	Chemical formula	Notes	Additional information	Cast iron (EN-GJL-200)
Salts				
Ammonium bicarbonate	NH <sub>4</sub> HCO <sub>3</sub>	b, c	20 °C, 15 %	AQQE
Potassium bicarbonate	KHCO <sub>3</sub>	b, c	20 °C, 20 %	AQQE/AQQV
Sodium carbonate	Na <sub>2</sub> CO <sub>3</sub>	b, c, f	20 °C, 20 %	AQQE
Sodium nitrate	NaNO <sub>3</sub>	b, c	20 °C, 5 %	AQQE/AQQV
Sodium nitrite	NaNO <sub>2</sub>	b, c	20 °C, 20 %	AQQE/AQQV
Sodium phosphate (di)	Na <sub>2</sub> HPO <sub>4</sub>	b, c, f	30 °C, 30 %	AQQE/AQQV
Sodium phosphate (tri)	Na <sub>3</sub> PO <sub>4</sub>	b, c, f	20 °C, 10 %	AQQE/AQQV
Sodium sulphite	Na <sub>2</sub> SO <sub>3</sub>	b, c, f	20 °C, 1 %	AQQE/AQQV
Alkalies				
Ammonium hydroxide	NH <sub>4</sub> OH		30 °C, 30 %	AQQE
Calcium hydroxide	Ca(OH) <sub>2</sub>	b	30 °C, 5 %	AQQE
Potassium hydroxide	КОН	c, f	20 °C, 20 %	AQQE
Sodium hydroxide	NaOH	c, f	20 °C, 20 %	AQQE

# Pump

The CMV pumps are non-self-priming, vertical, multistage centrifugal pumps. The pumps have a radial suction port in the bottom part and radial discharge port in the top part.

All movable parts are made of stainless steel.

All pumps incorporate a maintenance-free mechanical O-ring shaft seal with fixed driver.



Fig. 9 CMV pumps

# Motor

CMV pumps are fitted with totally enclosed, fan-cooled, 2-pole motors with principal dimensions to EN 50347.

Electrical tolerances comply with EN 60034.

# **Electrical data**

Insulation class	F
Enclosure class	IP55*
Supply voltages (tolerance ± 10 %)	1 x 220-240 V, 50 Hz 3 x 220-240/380-415 V, 50 Hz

IP55 is not recommended for operation in condensing environments. For operation in such environments, see Operation in condensing environments on page 11.

# High-efficiency motors

CMV motors comply with the MEPS requirements in different parts of the world, for example the EuP directive in the EU and KEMCO in Korea.

This means that CMV motors as minimum are living up to IE2 efficiency levels. IE3 motors are available on request. Please contact Grundfos.

## Motor protection

#### Mains-operated motors (CMV)

Single-phase motors, 1 x 115/230 V, 60 Hz\*, do not incorporate motor protection and must be connected to a motor-protective circuit breaker which can be manually reset. Set the motor-protective circuit breaker according to the rated current of the motor  $(I_{1/1})$ . See nameplate.

CMV

\* 60 Hz supply voltages are available on request.

Other single-phase motors have built-in current- and temperature-dependent motor protection in accordance with IEC 60034-11 and require no further motor protection. The motor protection is of the TP 211 type, which reacts to both slow- and quick-rising temperatures. The motor protection is automatically reset.

Three-phase motors must be connected to a motor-protective circuit breaker which can be manually reset. Set the motor-protective circuit breaker according to the rated current of the motor  $(I_{1/1})$ . See nameplate.

# Frequency converter operation

All three-phase motors can be connected to a frequency converter. Depending on the frequency converter type, this may cause increased acoustic noise from the motor. Furthermore, it may cause the motor to be exposed to detrimental voltage peaks.

As standard MG 71- and MG 80-based motors have no phase insulation and must therefore be protected against voltage peaks higher than 650 V (peak value) between the supply terminals.

Note: MG 71- and MG 80-based motors with phase insulation are available on request.

The above disturbances, i.e. both increased acoustic noise and detrimental voltage peaks, can be eliminated by fitting an LC filter between the frequency converter and the motor.

For further information, please contact the frequency converter supplier or Grundfos.

Construction

16



# Shaft seal

The shaft seal for the CMV pumps is of the O-ring type, which makes it very flexible when different types of O-rings and seal-face materials are required. The shaft seal has a fixed seal driver which ensures a reliable rotation of all parts, even under the most extreme operating conditions.

Due to the special design of the shaft seal and the interfaces to the rest of the pump construction, the dry-running capabilities are improved significantly compared to most other similar shaft seals and pump types. Furthermore, improvements have been made to reduce the risk and effect of sticking. The shaft seal types available can be found in *Selection of shaft seal* on page 25 where the key parameters of selecting a shaft seal are also described.



FM04 3933 0409

Fig. 10 Exploded view of shaft seal

**Note:** The available shaft seals for CMV pumps are very robust and durable, but dry running must always be avoided.

Details regarding operating conditions for the shaft seal can be found in *Operating range of the shaft seal* on page 11.

Further information about the shaft seal can be found in the separate data booklet covering shaft seals which can be downloaded from WebCAPS.

See 22. Further product documentation on page 41.


Title	Publication number
Shaft seals	96519875

# Construction

10

# CMV 5

# Sectional drawing

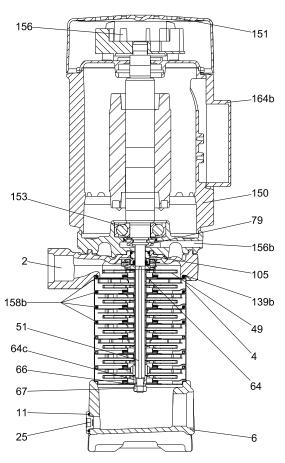

## Fig. 11 CMV 5-8 with MG90SA motor

#### Components

Pos.	Component	Pos.	Component	Pos.	Component
2	Discharge part	64c	Clamp	153	Ball bearing
4	Chamber	66	Washer (NORD-LOCK <sup>®</sup> )	156	Fan
6	Inlet part	67	Nut	156b	Motor flange
11	O-ring	79	Diverting disc	158b	O-ring
25	Plug	105	Shaft seal	164b	Terminal box
49	Impeller	139b	Gasket		
51	Pump shaft	150	Stator housing		
64	Spacing pipe	151	Fan cover		

Construction

# Material specification

Pos.	Description	Material	DIN	ISO/AISI/ASTM
Motor parts				
156b	Motor flange	Cast iron		
150	Stator housing	Silumin (Alu)		
151	Fan cover	Composite PBT/PC		
153	Ball bearing			
156	Fan	Composite PA 66 30 % GF		
164b	Terminal box, MG	Composite PC/ASA or silumin (Alu)		
79	Diverting disc	Silicone fluid (LSR)		
Pump parts				
105	Shaft seal, steel parts	Stainless steel	1.4301	AISI 304
105	Shaft seal, seal faces	Al <sub>2</sub> O <sub>3</sub> /carbon or SiC		
51	Pump shaft	Stainless steel	1.4057	AISI 431
11 158b <sup>2)</sup>	O-rings	EPDM or FKM		
139b	Gasket	Aramide fibres (nbr)		
2	Discharge part	Cast iron		
6	Inlet part	Cast iron		
4	Chamber	Stainless steel	1.4301	AISI 304
25	Plug	Stainless steel	1.4404	AISI 316L
49	Impeller	Stainless steel	1.4301	AISI 304
64	Spacing pipe	Stainless steel	1.4401	AISI 316
64c	Clamp	Stainless steel	STX2000 <sup>1)</sup>	
67	Nut	Stainless steel A4		
66	Washer (NORD-LOCK <sup>®</sup> )	Steel	1.4547	

<sup>1)</sup> STX2000 ~ CrNiMO 22 19 4.

 $^{2)}\;$  Only in CMV pumps with seven or more stages.

# 11. Grundfos CUE

CMV pumps connected to Grundfos CUE frequency converters



**3rA 4404** 

Fig. 12 Grundfos CUE product range

Grundfos CUE is a complete range of frequency converters for pump control in a wide range of applications. Grundfos CUE is designed for wall mounting.

Grundfos CUE provides a variety of benefits to the end-user.

The benefits include

- · Grundfos E-pump functionality and user interface
- · application- and pump family-related functions
- increased comfort compared to mains-operated pump solutions
- simple installation and commissioning compared to standard frequency converters.

## **Functions**

#### Intuitive start-up guide

The start-up guide enables easy installation and commissioning as well as plug-and-pump convenience. Few settings need to be made by the installer as the rest is done automatically or preset from the factory.

#### Smart user interface



-M04 3283 4108

Fig. 13 Grundfos CUE control panel

Grundfos CUE features a unique user-friendly control panel with graphic display and easy-to-use buttons. Panel layout resembles the well-known Grundfos R100 remote control, which is used with Grundfos E-pumps.

#### Controlling the value you choose

Grundfos CUE has a built-in PI controller offering closed-loop control of a desired value.

The values include

- constant differential pressure
- proportional pressure
- constant temperature
- · constant flow.

#### Wide product range

The CUE product range is quite comprehensive, covering five different voltage ranges, enclosure classes IP20/21 (Nema 1) and IP54/55 (Nema 12), and a wide range of output powers.

The table below provides a general overview.

Input voltage [V]	Output voltage [V]	Motor [kW]
1 x 200-240	3 x 200-240	1.1 - 7.5
3 x 200-240	3 x 200-240	0.75 - 45
3 x 380-500	3 x 380-500	0.55 - 250
3 x 525-600	3 x 525-600	0.75 - 7.5

TM03 3091 0206

TM02 1695 1901

# 12. Approvals and markings

# Approvals

# CB certificate, IEC countries.

# C-tick mark, New Zealand and Australian EMC.

# EC declaration of conformity

- Machinery Directive (2006/42/EC).
  - Standards used:
     EN 809: 2008 and EN 60204-1: 2006.
- Low Voltage Directive (2006/95/EC). Applicable when the rated power is lower than 2.2 kW.
  - Standards used: EN 60335-1: 2002 and EN 60335-2-51: 2003.
- EMC Directive (2004/108/EC).

# Other approvals and compliance with directives

- GOST (Russia)
- Compliance with RoHS, directive 2002/96/EC
- KEMCO.

# Drinking water approvals

ACS.

# Markings






Fig. 14 C-tick mark

CE mark



Fig. 15 CE mark

# 13. Certificates

Certificate	Description
Certificate of compliance with the order	According to EN 10204, 2.1. Grundfos document certifying that the pump supplied is in compliance with the order specifications.
Test certificate. Non-specific inspection and testing	According to EN 10204, 2.2. Certificate with inspection and test results of a non-specific pump.
Inspection certificate 3.1	Grundfos document certifying that the pump supplied is in compliance with the order specifications. Inspection and test results are mentioned in the certificate.
Inspection certificate	Grundfos document certifying that the pump supplied is in compliance with the order specifications. Inspection and test results are mentioned in the certificate. Certificate from the surveyor is included. We offer the following inspection certificates: Lloyds Register of Shipping (LRS) Det Norske Veritas (DNV) Germanischer Lloyd (GL) Bureau Veritas (BV) American Bureau of Shipping (ABS) Registro Italiano Navale Agenture (RINA) China Classification Society (CCS) Russian maritime register of Shipping (RS) Biro Klassifikasio Indonesia (BKI) United States Coast Guard (USCG) Nippon Kaiji Koykai (NKK)
Vibration report	Vibration report indicating the values measured during the performance test of the specific pump according to ISO 10816.
Motor test report	Shows the performance test of the specific motor, including power output, current, temperature, stator windings resistance and insulation test.
Cleaned and dried pump	Confirms that the specific pump has been cleaned and dried, and how it was done.
Electro-polished pump	Confirms that the specific pump has been electro-polished. The maximum surface roughness is specified in the report.

Examples of the certificates are shown on pages 23.

Note: Other certificates are available on request.

Certificates

# Examples of certificates

UNDFOS order no.	Certificate of comp	liance with the order			Test certificate
	THINK≯INNOVATE≯	GRUNDFOS	BE>	THINK \$ INNOVATE \$	
	Certificate of comp	liance with the order			Test certificate
<form></form>	- EN 10	204.2.1		Non-s	pecific inspection and testing
	EN 10	1204 2.1			
			Cust	omer name	
	tomer Tag no.		GRU	NDFOS order no.	
			Pum	In	
			Pum	ip type	
encode of the improprietic catalogues, durange and/or specifications relative therefs.       Bindboods Bind	the undersigned hereby guarantee and certi we mentioned product were manufactured.	ify that the materials and/or parts for the tested, inspected, and conform to the full re-	Flow	or make /	
			Volt	age	V
CONTOR     Operation       Control     Section       Section     Section			Full	load current	A
CRUNDICS     CRUNDICS     Draw			Mot	or speed	min <sup>-1</sup>
Difference       Difference <th></th> <th></th> <th></th> <th></th> <th></th>					
Inspection certificate 3.1     Inspection certificate.       DINEXDINOVATE>     CRUNDFOS       Dispection certificate.     Ex 10204 3.1       Indictured by     Inspection certificate.       NUMOPS order no.     Inspection certificate.       Dispection certificate     Inspection ce			206		
Inspection certificate 3.1     Inspection certificate.       DINING JINNOVATE>     CRUNDEGS       Dispection certificate.     EN 10204 3.1       Indictured by     Inspection certificate.       UNDOPS official     CRUNDEGS       Diverse building     CRUNDEGS official       part of rates     CRUNDEGS official       Diverse building     CRUNDEGS official       part of rates     CRUNDEGS official       part official     CRUNDEGS official       part official     CRUNDEG			5 1		
Inspection certificate 3.1  In			416		
Inspection certificate 3.1  In		Part no. 96 50 78 95/1001002			Part no 96 50 78 96/1001002
			TM		
<section-header></section-header>	Inspection of	certificate 3.1			Inspection certificate
EN 19204 3.1         nufactured by         nufactured by         NDPGS order no.         NDPGS order no.         CRUNDFOS DUTI d.         GRUNDFOS DUTI d.         GRUNDFOS order no.         address         y new building.         mer TAG no.         Dimer TAG no.         Stockty         GRUNDFOS autherized department.         oilfying sockty         Stockty         Dimer TAG no.         Dimer TAG no.         Dimer TAG no.         Stop / rebuilding.         GRUNDFOS autherized department.         oilfying sockty         Order no.         Customer cander no.         Customer c	→THINK → INNOVATE >	GRUNDFOS M	BE>	THINK \$ INNOVATE \$	
UNDFOS order no.					
tomer rane					
Jaddress	nufactured by UNDFOS order no.		Man	ufactured by	
pyrard / factory	EN 10: Inufactured by UNDFOS order no. UNDFOS DUT id. Stomer order no.		GRU	NDFOS order no. NDFOS DUT id.	
stomer TAG no.	EN 10: INUFOS order no. UNDFOS DUT id. Stomer order no. stomer name a dadress		GRU Cust	NDFOS order no. NDFOS DUT id. omer order no.	
mp       Motor         mp type       Make         mp type       Make         mp type       Make         mp type       Make         ial no.       Serial No.         ad (m)       Voltage (V)         ad (m)       Voltage (V)         w rate (m <sup>2</sup> /h)       Current (A)         Serial no.       Serial No.         scope.Pr/L(bar /*C)       Current (A)         Current (A)       Serial no.         scope.Pr/L(bar /*C)       Current (A)	EN 10: INDFOS order no. UNDFOS DUT id. stomer order no. stomer name 1 address pyraf / factory		GRU GRU Cust Cust and	NDFOS order no. NDFOS DUT id. omer order no. omer name address	
mp       Motor         mp type       Make	EN 10: INDFOS order no. UNDFOS DUT id. stomer order no. stomer name 1 address p/ new building stomer TAG no.		GRU GRU Cust Cust and Ship Ship	NDFOS order no. NDFOS DUT id. omer order no. omer name address yard / factory / new building	
Part number       Part number       Make         main no.       Serial No.       Serial No.         wr ate (m/h)       P2 (W)       Serial No.         ad (m)       Voltage (V)       Serial No.         xx. ope. Prt (bar / *C)       Current (A)       Serial No.         ser/Pump head cover       Insulation class       Flow rate (m'/h)       P2 (WM)         ser/Pump head cover       Frequency (Hz)       Make       Make         peller/guidexanes       Insulation class       m(min *)       Service       n(min *)         stomer's requirements       Wrate (m'/h)       Head (m)       Medium       Dir /W No.       Insulation class         stomer's requirements       Insulation class       Service       No       Insulation class         stronger's requirements       Impeller/guidexanes       Impeller/guidexanes       Impeller/guidexanes         n'h)       H(m)       n(min *)       Head (m)       Shaft viseeve       Impeller/guidexanes         stronger for equirements       Impeller/guidexanes       Impeller/guidexanes       Impeller/guidexanes         n'h)       H(m)       n(min *)       Head (m)       Impeller/guidexanes       Impeller/guidexanes         stronger for equirements       Impeller/guidexanes       Impel	EN 10: INUFGS order no. UNDFOS DUT id. stomer order no. stomer name d address byrard / factory p/ new building somer TAG no. Stomer TAG no. GRUNDFOS authorized	i department	GRU GRU Cust and Ship Ship	NDFOS order no. NDFOS DUT id. omer order no. omer name address yard / factory / new building omer TAG no.	ussian Maritime Register of Shipping ( RS )
wr rate (m <sup>2</sup> /h)       P2 (W)         ad (m)       Voltage (V)         xx. ope. P/t (bar /*C)       Current (A)         Din / W No.       n(min <sup>2</sup> )         selPump head cover       Frequency (Hz)         peller/guidevanes       Insulation class         dif/sleeve       Power factor         stomer's requirements       Power factor         wr rate (m <sup>2</sup> /h)       Head (m)         m/h)       Head (m)         m/h)       It/do static test         Bar - no leaks or deformation observed       Customer's requirements         Q(m <sup>2</sup> /h)       H(m)         m/ho       It/(A)         P1(kWV)       Head (m)	EN 10: anufactured by UNDFOS order no. UNDFOS DUT id. stomer order no. stomer name d address jayard / factory jp / new building stomer TAG no. stomer TAG no. stomer TAG no. stomer TAG no. stomer TAG no.	i department Motor Make	GRU Cust and Ship Ship Cust Class Class	NDFOS order no. NDFOS DUT id. omer order no. omer name address yard / factory / new building omer TAG no. sifying society R	Motor
Dir, V. op.       Current (A)       Max. ope. P/t (bar / *C)       Voltage (V)         Dir, V. No.       Infinit <sup>1</sup> )       Max. ope. P/t (bar / *C)       Current (A)         selPump head cover       Insulation class       Service       n(min <sup>1</sup> )         aft/sleeve       Power factor       Service       Nedium       Frequency (Hz)         stomer's requirements       Insulation class       Insulation class       Service         w rate (m/h)       Head (m)       Impeller/guidevanes       Impeller/guidevanes       Impeller/guidevanes         */h       H(m)       n(min <sup>3</sup> )       I(A)       P1(kW)       Shaft/Sleeve       Impeller/guidevanes         */h       Bar – no leaks or deformation observed       Customer's requirements       Impeller/guidevanes       Impeller/guidevanes         Q(m'/h)       H(m)       n(min <sup>3</sup> )       I(A)       P1(kW)       Impeller/guidevanes       Impeller/guidevanes         Test result ref. requirements       Impeller/guidevanes       Impeller/guidevanes       Impeller/guidevanes       Impeller/guidevanes         (Mortstatic test       Bar – no leaks or deformation observed       Impeller/guidevanes       Impeller/guidevanes         (m/h)       H(m)       In(min <sup>3</sup> )       I(A)       P1(kW)         The pump has been marked	EN 10: INUFICS order no. UNDFOS order no. Stomer order no. Stomer order no. Stomer name a dadress Ipyard / factory // new building stomer TAG no. stoffing society GRUNDFOS authorized mp mp type rt number	i department Motor Make Part number	GRU GRU Cust and Ship Ship Cust Class Class Pum Pum	NDFOS order no. NDFOS DUT id. omer order no. omer name address yard / factory / new building omer TAG no. ifying society P p type	Motor Make
Din / W No.       n(min <sup>2</sup> )         Se/Pump head cover       n(min <sup>2</sup> )         peller/guidewanes       insulation class         aff/sleeve       Power factor         somer's requirements       Base-Plum head cover         wrate (m <sup>2</sup> /h)       Head (m)         tresult rsf. requirements       Service         m <sup>2</sup> /h)       H(m)         former's requirements       Service         (drostatic test)       Bar - no leaks or deformation observed         (gm'/h)       H(m)       In(min <sup>2</sup> )         Hydrostatic test       Bar - no leaks or deformation observed         The pump has been marked       Surveor sinature         Surveor sinature       GRUNDFOS	EN 10: anufactured by UNDFOS order no. UNDFOS DUT id. stomer order no. stomer name a dadress juyard / factory juy / new building stomer TAG no. sistifying society GRUNDFOS authorized mp mp type rt number rial no. w rate (m'/h)	i department Motor Make Part number Serial No. P2 (kW)	GRU GRU Cust and Ship Ship Cust Class Class Pum Part Seria Seria Ship	NDFOS order no. NDFOS DUT id. omer order no. omer order no. omer name address yard / factory / new building omer TAG no. sifying society P p type number l no.	Motor Make Part number Serial No.
All of the second se	EN 10: anufactured by IUNDFOS order no. IUNDFOS DUT id. stomer order no. stomer name a dadress ipyard / factory ipy / new building stomer TAG no. assifying society GRUNDFOS authorized imp mp type rit number rial no. w rate (m'/h) ad (m) ax. ope. P/f (bar / °C)	I department Motor Make Part number Serial No. P2 (kW) Voltage (V) Current (A)	GRU GRU Cust Cust Ship Ship Cust Class Class Pum Part Few Flow Hea	NDFOS order no. NDFOS DUT id. omer order no. omer name address address address address yard / factory / new building omer TAG no. sifying society R P P p type number number number no. a fo. a fo. a fo. a fo. a fo. a fo. a fo. a fo. b	Motor Make Part number Serial No. P2 (kW) Voltage (V)
Base/Pump head cover       Power factor         w rate (m/h)       Head (m)         it result ref. requirements       Shaft/sleeve         m'/h)       H(m)         m/h)       H(m)         Bar - no leaks or deformation observed       Flow rate (m'/h)         (m/h)       H(m)         Head (m)       Head (m)         Customer's requirements         (m/r/h)       Head (m)         Flow rate (m'/h)       Head (m)         (m/r/h)       Head (m)         Itest result ref. requirements       (m/r/h)         (m/r/h)       H(m)         (m/r/h)       Head (m)         Test result ref. requirements       (m/r/h)         Q(m/r/h)       H(m)         (m/r)       H(m)         (m/r) <td>EN 10: anufactured by UNDFGS order no. UNDFGS DUT id. stomer order no. stomer order no. stomer name a dadress jayrad / factory jar / new building stomer TAG no. ussifying society GRUNDFOS authorized mp mp type mp type mp type mp type main (n') ad (m) xx. ope. P/r (bar / °C) Din / W No.</td> <td>i department Motor Make Part number Serial No. P2 (kW) Voltage (V) Current (A) n (min<sup>2</sup>)</td> <td>GRU GRU Cust Cust Cust Cust Class Class Cust Class Pum Part Part Flow Hea Hea Max</td> <td>NDFOS order no. NDFOS DUT id. omer order no. omer name address address address omer TAG no. ifying society <b>R</b> <b>P</b> <b>type</b> number number il no. rate (m<sup>7</sup>/h) d (m) ope. P/t (bar / <sup>e</sup>C)</td> <td>Motor           Make           Part number           Serial No.           P2 (kW)           Voltage (V)           Current (A)</td>	EN 10: anufactured by UNDFGS order no. UNDFGS DUT id. stomer order no. stomer order no. stomer name a dadress jayrad / factory jar / new building stomer TAG no. ussifying society GRUNDFOS authorized mp mp type mp type mp type mp type main (n') ad (m) xx. ope. P/r (bar / °C) Din / W No.	i department Motor Make Part number Serial No. P2 (kW) Voltage (V) Current (A) n (min <sup>2</sup> )	GRU GRU Cust Cust Cust Cust Class Class Cust Class Pum Part Part Flow Hea Hea Max	NDFOS order no. NDFOS DUT id. omer order no. omer name address address address omer TAG no. ifying society <b>R</b> <b>P</b> <b>type</b> number number il no. rate (m <sup>7</sup> /h) d (m) ope. P/t (bar / <sup>e</sup> C)	Motor           Make           Part number           Serial No.           P2 (kW)           Voltage (V)           Current (A)
iomer's requirements       impeller/guidevanes       impeller/guidevanes         vrate (m²/h)       Head (m)       Shaft/sleeve       Shaft/sleeve         result ref, requirements       Customer's requirements       Shaft/sleeve       Shaft/sleeve         drostatic test       Bar - no leaks or deformation observed       Elow rate (m²/h)       H(m)       II(A)         Humpeloos       H(m)       II(A)       P1(kW)       H(m)       II(A)         Optimized       Bar - no leaks or deformation observed       Hydrostatic test       Bar - no leaks or deformation observed         Hydrostatic test       Bar - no leaks or deformation observed       The pump has been marked       Medicate test	EN 10:  NDFOS order no.  NDFOS bUT id.  tomer order no.  tomer order no.  tomer order no.  tomer name address  pyard / factory  / new building  tomer TAG no.  soffying society  GRUNDFOS authorized  p p type tnumber al no.  at no.  building  trace (m'/h) ad (m)  c. ope. Pr( [bar / *C])  Din / W No.  eller/guidevanes	i department Motor Make Part number Serial No. P2 (kW) Voltage (V) Current (A) n(min <sup>-</sup> ) Frequency (H2) Insultion class	GRU GRU Cust Cust Ship Ship Cust Class Pum Part Flow Flow Hear Max Seric	NDFOS order no. NDFOS DUT id. omer order no. omer name address address address omer TAG no. ifying society <b>R</b> <b>P</b> <b>P</b> <b>P</b> <b>P</b> <b>P</b> <b>P</b> <b>P</b> <b>P</b>	Motor Make Part number Serial No. P2 (kW) Voltage (V) Current (A) n(min <sup>-1</sup> ) Frequency (H2)
Customer's requirements           '/h)          H(m)          n(min <sup>-1</sup> )          I(A)          P1(kW)           Irostatic test         Bar - no leaks or deformation observed         Image: Customer's requirements         [Cum'/h)          H(m)          I(A)         P1(kW)           Irostatic test         Bar - no leaks or deformation observed         Image: Customer's requirements         [Cum'/h)          H(m)          I(A)         P1(kW)           Hydrostatic test         Bar - no leaks or deformation observed         Image: Customer's requirements         [Cum'/h)         Image: Customer's requirements         [Cum'/h)         [Hydrostatic test         Bar - no leaks or deformation observed         [Hydrostatic test         [Bar - no leaks or deformation observed]         [Hydrostatic test         [Bar - no leaks or deformation observed]         [Huptomather customer's requirements]         [Customer's require	EN 10:	i department Motor Make Part number Serial No. P2 (kW) Voltage (V) Current (A) n(min <sup>-</sup> ) Frequency (H2) Insultion class	GRU GRU GRU Cust Cust Cust Cust Ship Cust Class Class Part Part Seri Flow Hea Max Seri Base Seri Base	NDFOS order no. NDFOS DUT id. omer order no. omer name address address address omer TAG no. iflying society P type p type no. no. p type n rate (m //h) d (m). ope. P/t (bar / *C) ice ium D //Purup head cover	Motor           Make           Part number           Serial No.           P2 (W)           Voltage (V)           Current (A)           n(min <sup>-1</sup> )           Frequency (Hz)           In y Lation class
'/h)        H(m)        n(min <sup>-1</sup> )        I(A)        P1(kW)         Irostatic test        Bar - no leaks or deformation observed        Flow rate (m'/h)        H(m)        P1(kW)         (GPLINDEOS        Flow rate (m'/h)        H(m)        I(A)        P1(kW)         (GPLINDEOS        Flow rate (m'/h)        H(m)        I(A)        P1(kW)	EN 10: INDFOS order no. INDFOS order no. INDFOS DUTId. INDFOS DUTId. Intervention of the second	I department Motor Make Part number Serial No. P2 (kW) Voltage (V) Current (A) n(min <sup>-1</sup> ) Frequency (H2) Insulation class Power factor	GRU GRU GRU Cust Cust Cust Cust Class Class Class Serie Flow Flow Heat Max Serie Flow Flow Flow Heat Max Serie Flow Flow Flow Flow Flow Flow Flow Flow	NDFOS order no. NDFOS DUT id. omer order no. omer name address yard / factory / new building omer TAG no. ifying society <b>P</b> <b>P</b> <b>P</b> <b>P</b> <b>P</b> <b>P</b> <b>P</b> <b>P</b>	Motor           Make           Part number           Serial No.           P2 (W)           Voltage (V)           Current (A)           n(min <sup>-1</sup> )           Frequency (Hz)           In y Lation class
Q(m <sup>1</sup> /h)      H(m)       I(A)      P1(kW)       Hydrostatic test     Bar - no leaks or deformation observed       The pump has been marked       Surveyor signature:     GRUNDEOS	EN 10: INDFOS order no. INDFOS order no. INDFOS DUTId. INDFOS DUTId. Intervention of the second	I department Motor Make Part number Serial No. P2 (kW) Voltage (V) Current (A) n(min <sup>-1</sup> ) Frequency (H2) Insulation class Power factor	GRU GRU GRU GRU Cust Cust Cust Class Class Class Serie Flow Flow Flow Flow Flow Flow Flow Flow	NDFOS order no. NDFOS DUT id. omer order no. omer name address yard / factory / new building omer TAG no. ifying society <b>P</b> <b>P</b> <b>P</b> <b>P</b> <b>P</b> <b>P</b> <b>P</b> <b>P</b>	Motor           Make           Part number           Serial No.           P2 (W)           Voltage (V)           Current (A)           n(min <sup>-1</sup> )           Frequency (Hz)           In y Lation class
Q(m <sup>1</sup> /h)      H(m)      n(min <sup>-1</sup> )      I(A)      P2(kW)       Hydrostatic test      Bar - no leaks or deformation observed       The pump has been marked       Surveyor signature:     GRUNDEOS	EN 10:	I department Motor Make Part number Serial No. P2 (kW) Voltage (V) Current (A) n(min <sup>3</sup> ) Frequency (H2) Insultion class Power factor Head (m)	GRU GRU GRU Cust Cust Cust Cust Ship Cust Class Part Seri Seri Seri Seri Seri Seri Seri Seri	NDFGS order no. NDFGS DUT id. omer order no. omer name address address address omer TAG no. iflying society P bype no. mer TAG no. p type no. no. p type n rate (m'/h) d (m). ope. P/t (bar / "C) ice lium D /Pump head cover eller/guidevanes t/sleeve	Motor           Make           Part number           Serial No.           P2 (kW)           Voltage (V)           Current (A)           n(min <sup>3</sup> )           Frequency (Hz)           in / W No.           Power factor
CPUINDEOS Surveyor signature: GRUNDEOS	EN 10:	I department           Motor           Make           Part number           Serial No.           P2 (kW)           Voltage (V)           Current (A)           n(min <sup>3</sup> )           Frequency (Hz)           Insulation class           Power factor           Head (m)           I(A)         P1(kW)	GRU GRU GRU GRU Cust Cust Cust Cust Cust Cust Cust Cust	NDFGS order no. NDFGS DUT id. omer order no. omer name address yard / factory / new building omer TAG no. ifying society R P P p type number in no. no. rate (m/h) d (m) .ope. P/t (bar / *C) ice ler/guidevanes tyleeve omer's requirements reat (m/h) result ref. requirement	Motor           Make           Part number           Serial No.           P2 (W)           Voltage (V)           Current (A)           n(min *)           Frequency (Hz)           in / W No.           Head (m)
GPLINDEOS Surveyor signature: GRUNDEOS	EN 10:       nufactured by     INDFOS order no.       INDFOS bUTid.     Index of the second	I department           Motor           Make           Part number           Serial No.           P2 (kW)           Voltage (V)           Current (A)           n(min <sup>3</sup> )           Frequency (Hz)           Insulation class           Power factor           Head (m)           I(A)         P1(kW)	GRU GRU GRU GRU Cust Cust Cust Cust Cust Cust Cust Cust	NDFGS order no. NDFGS DUT id. omer order no. omer name address yard / factory / new building omer TAG no. ifying society R P P p type number in no. no. rate (m/h) d (m) .ope. P/t (bar / *C) ice ler/guidevanes tyleeve omer's requirements reat (m/h) result ref. requirement	Motor           Make           Part number           Serial No.           P2 (W)           Voltage (V)           Current (A)           n(min *)           Frequency (Hz)           in / W No.           Head (m)
GRUNDFOS Surveyor signature: GRUNDFOS	EN 10:       mufactured by     INDPOS order no.       UNDPOS DUT id.     Stomer order no.       stomer order no.     Stomer order no.       stomer TAG no.     Stomer TAG no.       stomer tag no.     GRUNDFOS authorized       mp     mp       mp type     th number       tal no.     wirate (m/h)       ad (m)     Stomer TAG no.       se/Pump head cover     Din / W No.       se/Pump head cover     Epier/guidevanes       aft/sleeve     Stomer srequirements       wrate (m/h)     H(m)	I department           Motor           Make           Part number           Serial No.           P2 (kW)           Voltage (V)           Current (A)           n(min <sup>3</sup> )           Frequency (Hz)           Insulation class           Power factor           Head (m)           I(A)         P1(kW)	GRU GRU GRU GRU Cust Cust Cust Cust Cust Cust Cust Cust	NDFOS order no.           NDFOS DUT id.           ormer order no.           ormer order no.           ormer and           address           address           yard / factory           / new building           ormer TAG no.           ifying society           P           p type           no.           n rote (m/h)           d (m)           ope. P/t (bar / *C)           ice           eller/guidevanes           t/sleeve           torder's requirements           rate (m'/h)           H(m)	Motor           Make           Part number           Serial No.           P2 (kW)           Voltage (V)           Current (A)           n(min*)           frequency (Hz)           in / W No.           Head (m)           Ital (A)           Part (A)
GRUNDFOS     GRUNDFOS       Date:     Tested date:       Signature:     Signature:       Name:     Dept:       Dept:     Dept:	EN 10: anufactured by UUNDFOS order no. UUNDFOS order no. UUNDFOS DUT id. stomer order no. stomer name d address ipyard f factory ipy new building stomer TAG no. assifying society GRUNDFOS authorized mp mp type tri number tri numbe	I department           Motor           Make           Part number           Serial No.           P2 (kW)           Voltage (V)           Current (A)           n(min <sup>3</sup> )           Frequency (Hz)           Insulation class           Power factor           Head (m)           I(A)         P1(kW)	GRU GRU GRU GRU Cust Cust Cust Cust Cust Cust Cust Cust	NDFOS order no. NDFOS DUT id. omer order no. omer name address yard / factory / new building omer TAG no. ifying society R p type number p type number in no. ope. P/t (bar / *C) ice ium P/ump head cover eller/guidevanes t/sleeve omer's requirements rate (m /h) result ref, requirements /h    H(m) rotatic test	Motor           Make           Part number           Serial No.           P2 (kW)           Voltage (V)           Current (A)           n(min*)           Frequency (H2)           in / W No.           Insulation class           Power factor           Image (m)           Image (m)           Sector           Image (m)           Bar – no leaks or deformation observed
User.     Op     Concentration       Signature:     Name:       Dept:     Op	EN 10: anufactured by KUNDFOS order no. KUNDFOS DUT id. ustomer order no. ustomer name di address ipyard / factory ipy new building ustomer TAG no. assifying society GRUNDFOS authorized mp mp type rial no. owr rate (m'/h) ead (m) ax. ope. P/t (bar / *C) Din / W No. asse/Pump head cover peller/guidevanes aft/sileeve ustomers wrate (m'/h) st result ref. requirements m'/h) H(m) n(min*)	I department           Motor           Make           Part number           Serial No.           P2 (kW)           Voltage (V)           Current (A)           n(min <sup>3</sup> )           Frequency (Hz)           Insulation class           Power factor           Head (m)           I(A)         P1(kW)	GRU GRU GRU GRU Cust Cust Cust Cust Cust Cust Cust Cust	NDFOS order no. NDFOS DUT id. omer order no. omer name address yard / factory / new building omer TAG no. ifying society R p type number p type number in no. ope. P/t (bar / *C) ice ium P/ump head cover eller/guidevanes t/sleeve omer's requirements rate (m /h) result ref, requirements /h    H(m) rotatic test	Motor           Make           Part number           Serial No.           P2 (kW)           Voltage (V)           Current (A)           n(min*)           Frequency (H2)           in / W No.           Insulation class           Power factor           Image (m)           Image (m)           Sector           Image (m)           Bar – no leaks or deformation observed
Name: Dept: Tatio 55 50 Provinciano Partino 55	EN 10: anufactured by KUNDFOS order no. KUNDFOS DUT id. ustomer order no. ustomer name di address ipyard / factory ipy new building ustomer TAG no. assifying society GRUNDFOS authorized mp mp type rial no. owr rate (m'/h) ead (m) ax. ope. P/t (bar / *C) Din / W No. asse/Pump head cover peller/guidevanes aft/sileeve ustomers wrate (m'/h) st result ref. requirements m'/h) H(m) n(min*)	d department	GRU GRU GRU GRU Cust Cust Cust Cust Ship Cust Class Class Class Flow Head Head Base Server Med Base Server Shaf Cust Cust Cust Cust Cust Cust Cust Cust	NDFOS order no. NDFOS DUT id. omer order no. omer name address yard / factory / new building omer TAG no. ifying society R P p type number il no. ope. P/t (bar / *C) ice lium D //Pump head cover eller/guidevanes t/sleeve omer's requirements rate (m /h) result ref. requirements /h) M moratic test pump has been marked eyor signature:	Motor           Make           Part number           Serial No.           P2 (W)           Voltage (V)           Current (A)           n(min')           Frequency (H2)           in / W No.           Insulation class           Power factor           Image (m)           Image (m)           Bar – no leaks or deformation observed           d           GRUNDFOS
Testino 56 50 74 9770 ctabular	EN 10: anufactured by KUNDFOS order no. KUNDFOS DUT id. ustomer order no. ustomer name di address ipyard / factory ipy new building ustomer TAG no. assifying society GRUNDFOS authorized mp mp type rial no. owr rate (m'/h) ead (m) ax. ope. P/t (bar / *C) Din / W No. asse/Pump head cover peller/guidevanes aft/sileeve ustomers wrate (m'/h) st result ref. requirements m'/h) H(m) n(min*)	department           Make           Part number           22 (kW)           Voltage (V)           Voltage (V)           Current (A)           No.           Part number           State           Part number           Part number           State           Part number           Part number           State	GRU GRU GRU GRU Cust Cust Cust Cust Ship Cust Class Class Class Flow Head Head Base Server Med Base Server Shaf Cust Cust Cust Cust Cust Cust Cust Cust	NDFOS order no. NDFOS DUT id. omer order no. omer name address yard / factory / new building omer TAG no. ifying society R P p type number il no. ope. P/t (bar / *C) ice lium D //Pump head cover eller/guidevanes t/sleeve omer's requirements rate (m /h) result ref. requirements /h) M moratic test pump has been marked eyor signature:	Motor           Make           Part number           Serial No.           P2 (W)           Voltage (V)           Current (A)           n(min ')           Frequency (Hz)           in / W No.           Insultation class           Power factor           Image (m)           Bar - no leaks or deformation observed           d           GRUNDFOS           Date:
	EN 10: anufactured by UUNDFOS order no. UUNDFOS order no. Stomer order no. stomer name a daddress stomer Action ipy new building stomer TAG no. ssssfring society GRUNDFOS authorized mip mp type rt number rtal no. sv rate (m'/h) stomer //h) stomer //h stomer	id department           Motor           Make           Part number           Seat number           Voltage (V)           Voltage (V)           Current (A)           n(min*)           Frequency (Hz)           Insulation class           Power factor           Head (m)           It (A)           Pl(kW)           or deformation observed           GRUNDFOS           Date:           Signature:           Name:	GRU GRU GRU GRU Cust Cust Cust Cust Ship Cust Class Class Class Flow Head Head Base Server Med Base Server Shaf Cust Cust Cust Cust Cust Cust Cust Cust	NDFOS order no. NDFOS DUT id. omer order no. omer name address yard / factory / new building omer TAG no. ifying society R P p type number il no. ope. P/t (bar / *C) ice lium D //Pump head cover eller/guidevanes t/sleeve omer's requirements rate (m /h) result ref. requirements /h) M moratic test pump has been marked eyor signature:	Motor           Make           Part number           Serial No.           P2 (W)           Voltage (V)           Current (A)           n(min ')           Frequency (Hz)           in / W No.           Insultation class           Power factor           Image (m)           Bar - no leaks or deformation observed           Image (m)           GRUNDFOS           Date:           Signature:           Name:

Certificates

# 14. Selection and sizing

# Selection of pumps

Selection of pumps should be based on these elements:

- the duty point of the pump (see below)
- dimensional data such as pressure loss as a result of height differences, friction loss in the pipework, pump efficiency, etc. (see below)
- pump materials (see page 25)
- pump connections (see page 25)
- shaft seal (see page 25).

### Duty point of the pump

From a duty point it is possible to select a pump on the basis of the curve charts starting on page 27.

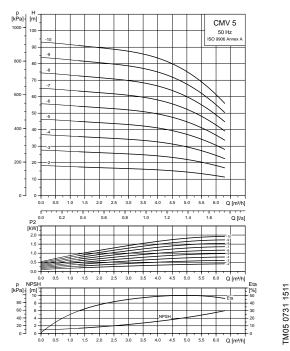


Fig. 16 Example of a curve chart

### **Dimensional data**

When sizing a pump, take the following factors into account:

- Required flow and pressure at the draw-off point.
- Pressure loss as a result of height differences  $(H_{\alpha eo})$ .
- Friction loss in the pipework (H<sub>f</sub>). It may be necessary to account for pressure loss in connection with long pipes, bends or valves, etc.
- Best efficiency at the estimated duty point.
- NPSH value.
   For calculation of the NPSH value, see *Minimum* inlet pressure, NPSH on page 12.

## Pump efficiency

When sizing the pump, the efficiency (eta) should be considered so that the pump will operate at or near its maximum efficiency, for instance on the right-hand side in the curve example in fig. 17.





Before determining the best efficiency point, the operation pattern of the pump needs to be identified. If the pump is expected to operate at the same duty point, then select a CMV pump which is operating at a duty point corresponding with the best efficiency of the pump. The example in fig. 18 shows how to check the pump efficiency when selecting a CMV pump.

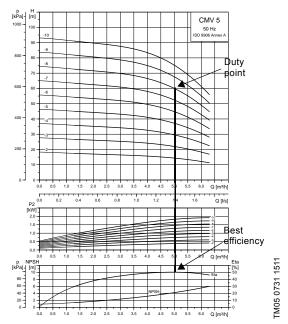


Fig. 18 Example of a CMV pump's duty point

## **Pump materials**

Select the material variant on the basis of the liquid to be pumped. The table below gives a general recommendation regarding selection of pump material.

Liquid to be pumped	Material in contact with pumped liquid	Pump type
Clean, non-aggressive liquids such as potable water and oils	Cast iron* (EN-GJL-200)	CMV-A

\* The impeller, chamber and filling plugs are made of stainless steel (EN 1.4301/AISI 304). The pump shaft is made of stainless steel (EN 1.4057/AISI 431).

The pump shart is made of stainless steer (EN 1.4037/AISI 431).

For more specific selection based on the pumped liquid, see *List of pumped liquids* on page 13, or contact Grundfos.

### **Pump connections**

Selection of pump connection depends on the rated pressure and pipework. To meet any requirement, the CMV pumps offer a wide range of flexible connections such as:

- Tri-Clamp<sup>®</sup>
- DIN/ANSI/JIS flange
- PJE/Victaulic<sup>®</sup> coupling
- · Whitworth thread Rp
- Internal NPT thread.

## Selection of shaft seal

As standard, the CMV pumps are fitted with a Grundfos O-ring type shaft seal with fixed driver suitable for the most common applications.



Fig. 19 Shaft seal (O-ring type with fixed driver)

The table below shows the available shaft seal types for CMV pumps.

Pump type	Shaft seal type	Material	Rubber parts
CMV	AQQE AQQV AVBE AVBV	Stainless steel	EPDM (E) FKM (V)

These key parameters must be taken into account when selecting the shaft seal:

- · type of pumped liquid
- liquid temperature
- maximum pressure.

Use the curve in fig. 8 on page 11 to select a suitable shaft seal. If the pumped liquid differs from water, a suitable shaft seal can be found in *List of pumped liquids* on pages 13 to 15.

**Note:** The list should be applied with some caution, as factors such as concentration of the pumped liquid, liquid temperature or pressure may affect the chemical resistance of a specific pump version.

Selection and sizing

# 15. How to read the curve charts

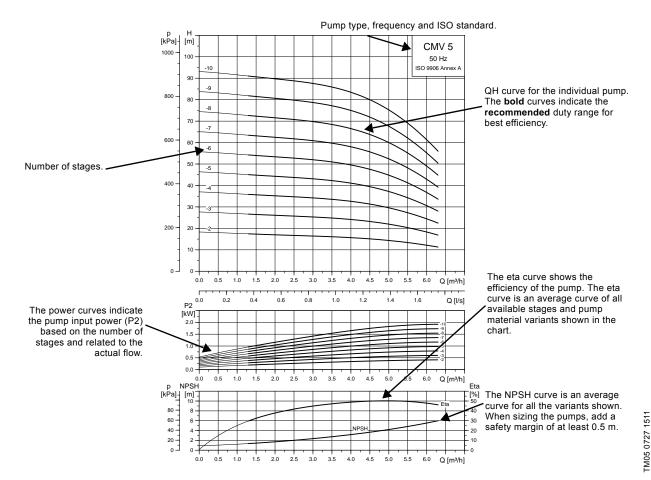


Fig. 20 How to read the curve charts

# **Guidelines to performance curves**

The guidelines below apply to the curves shown on the following pages:

- Tolerances to ISO 9906, Annex A, if indicated.
- Measurements have been made with airless water at a temperature of +20 °C.
- The curves apply to the following kinematic viscosity: μ = 1 mm<sup>2</sup>/s (1 cSt).
- The QH curves apply to fixed speeds of 2900 min<sup>-1</sup> (50 Hz).
   Note: Please refer to WebCAPS for pump curves which include the characteristic of the selected motor. In WebCAPS, it is also possible to adjust the curves depending on the density and viscosity.
- The conversion between head H (m) and pressure p (kPa) applies to a water density of  $\rho$  = 1000 kg/m<sup>3</sup>.

• Due to the risk of overheating, the pumps should not be used at a flow below the minimum flow rate. The curve in fig. 21 shows the minimum flow rate as a percentage of the rated flow rate in relation to the liquid temperature.


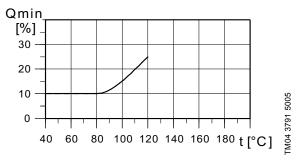


Fig. 21 Minimum flow rate

CMV 3 50 Hz

# 16. Performance curves, CMV, 50 Hz

CMV 3

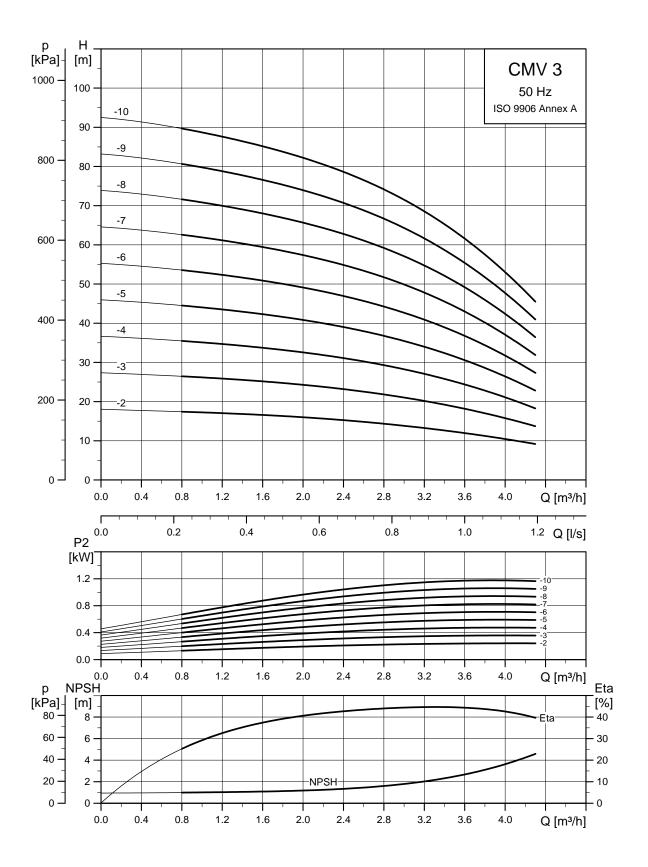


Performance curves, CMV, 50 Hz

TM05 0730 1511

CMV 5


16

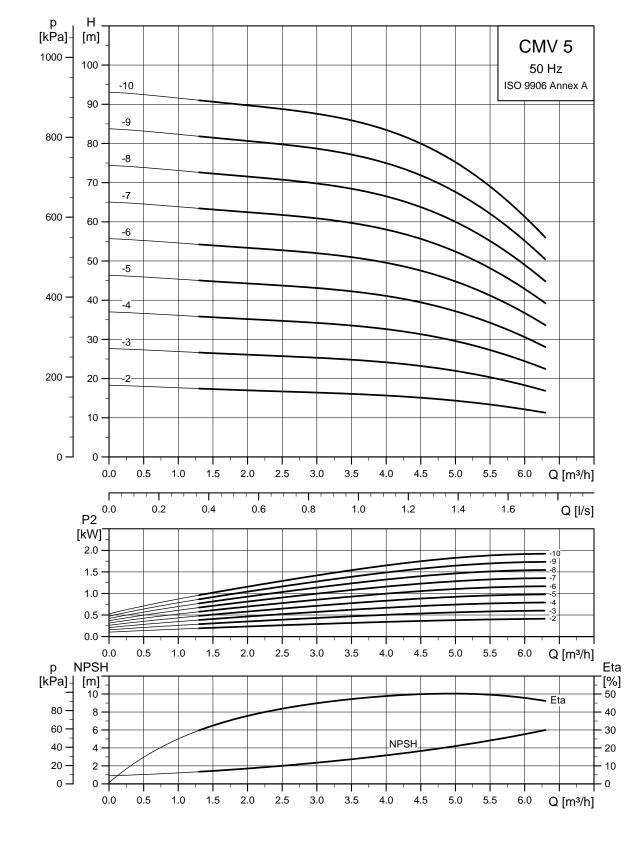

TM05 0731 1511

# 17. Dimensions, CMV 50 Hz

# CMV 3



# TM05 0851 1611

### Dimensions

# 1 x 220-240 V, 50 Hz (supply voltage C)


Dump time	Frame			Dimensions														
Pump type	size	P2 [kW]	A1	A2	A3	A4	н	H1	H2	HЗ	B1	B2	D1	D2	L1	L2	L3	L4
CMV 3-4	71B	0.5	Rp 1	Rp 1	Rp 3/8	14.0	362.9	50	161.2	111.2	126.0	95.0	142.0	133.0	191.0	160.0	65.0	73.5
CMV 3-5	71B	0.5	Rp 1	Rp 1	Rp 3/8	14.0	381.0	50	179.3	129.3	126.0	95.0	142.0	133.0	191.0	160.0	65.0	73.5
CMV 3-6	80A	0.67	Rp 1	Rp 1	Rp 3/8	14.0	439.1	50	197.4	147.4	126.0	95.0	142.0	133.0	191.0	160.0	65.0	73.5
CMV 3-7	80B	0.9	Rp 1	Rp 1	Rp 3/8	14.0	457.2	50	215.5	165.5	126.0	95.0	142.0	133.0	191.0	160.0	65.0	73.5
CMV 3-8	80B	0.9	Rp 1	Rp 1	Rp 3/8	14.0	475.3	50	233.6	183.6	126.0	95.0	142.0	133.0	191.0	160.0	65.0	73.5
CMV 3-9	90SA	1.3	Rp 1	Rp 1	Rp 3/8	14.0	545.0	50	238.4	188.4	126.0	95.0	178.0	139.0	191.0	160.0	65.0	111.0
CMV 3-10	90SA	1.3	Rp 1	Rp 1	Rp 3/8	14.0	563.1	50	256.5	206.5	126.0	95.0	178.0	139.0	191.0	160.0	65.0	111.0

## 3 x 220-240 V / 380-415 V, 50 Hz (supply voltage F)

Duman from a	Frame			Dimensions														
Pump type	size	P2 [kW]	A1	A2	A3	A4	н	H1	H2	H3	B1	B2	D1	D2	L1	L2	L3	L4
CMV 3-2	71A	0.46	Rp 1	Rp 1	Rp 3/8	14.0	326.7	50	125.0	75.0	126.0	95.0	142.0	109.0	191.0	160.0	65.0	73.5
CMV 3-3	71A	0.46	Rp 1	Rp 1	Rp 3/8	14.0	344.8	50	143.1	93.1	126.0	95.0	142.0	109.0	191.0	160.0	65.0	73.5
CMV 3-4	71A	0.46	Rp 1	Rp 1	Rp 3/8	14.0	362.9	50	161.2	111.2	126.0	95.0	142.0	109.0	191.0	160.0	65.0	73.5
CMV 3-5	71B	0.65	Rp 1	Rp 1	Rp 3/8	14.0	381.0	50	179.3	129.3	126.0	95.0	142.0	109.0	191.0	160.0	65.0	73.5
CMV 3-6	71B	0.65	Rp 1	Rp 1	Rp 3/8	14.0	399.1	50	197.4	147.4	126.0	95.0	142.0	109.0	191.0	160.0	65.0	73.5
CMV 3-7	80A	0.84	Rp 1	Rp 1	Rp 3/8	14.0	457.2	50	215.5	165.5	126.0	95.0	142.0	109.0	191.0	160.0	65.0	73.5
CMV 3-8	80B	1.2	Rp 1	Rp 1	Rp 3/8	14.0	495.3	50	233.6	183.6	126.0	95.0	142.0	109.0	191.0	160.0	65.0	73.5
CMV 3-9	80B	1.20	Rp 1	Rp 1	Rp 3/8	14.0	513.4	50	251.7	201.7	126.0	95.0	142.0	109.0	191.0	160.0	65.0	73.5
CMV 3-10	80B	1.20	Rp 1	Rp 1	Rp 3/8	14.0	531.5	50	269.8	219.8	126.0	95.0	142.0	109.0	191.0	160.0	65.0	73.5

17

# CMV 5



Dimensions

# 1 x 220-240 V, 50 Hz (supply voltage C)

	Frame									Dimen	sions							
Pump type	size	° P2 [kW]	A1	A2	A3	A4	н	H1	H2	H3	B1	B2	D1	D2	L1	L2	L3	L4
CMV 5-2	71B	0.5	Rp 1	Rp 1 1/4	Rp 3/8	14.0	326.7	50	125.0	75.0	126.0	95.0	142.0	133.0	191.0	160.0	65.0	73.5
CMV 5-3	71B	0.5	Rp 1	Rp 1 1/4	Rp 3/8	14.0	344.8	50	143.1	93.1	126.0	95.0	142.0	133.0	191.0	160.0	65.0	73.5
CMV 5-4	80A	0.67	Rp 1	Rp 1 1/4	Rp 3/8	14.0	402.9	50	161.2	111.2	126.0	95.0	142.0	133.0	191.0	160.0	65.0	73.5
CMV 5-5	80B	0.9	Rp 1	Rp 1 1/4	Rp 3/8	14.0	421.0	50	179.3	129.3	126.0	95.0	142.0	133.0	191.0	160.0	65.0	73.5
CMV 5-6	90SA	1.3	Rp 1	Rp 1 1/4	Rp 3/8	14.0	490.7	50	184.1	134.1	126.0	95.0	178.0	139.0	191.0	160.0	65.0	111.0
CMV 5-7	90SA	1.3	Rp 1	Rp 1 1/4	Rp 3/8	14.0	508.8	50	202.2	152.2	126.0	95.0	178.0	139.0	191.0	160.0	65.0	111.0
CMV 5-8	90SA	1.3	Rp 1	Rp 1 1/4	Rp 3/8	14.0	526.9	50	220.3	170.3	126.0	95.0	178.0	139.0	191.0	160.0	65.0	111.0
CMV 5-9	90SB	1.9	Rp 1	Rp 1 1/4	Rp 3/8	14.0	545.0	50	238.4	188.4	126.0	95.0	178.0	139.0	191.0	160.0	65.0	111.0
CMV 5-10	90SB	1.9	Rp 1	Rp 1 1/4	Rp 3/8	14.0	563.1	50	256.5	206.5	126.0	95.0	178.0	139.0	191.0	160.0	65.0	111.0

## 3 x 220-240 V / 380-415 V, 50 Hz (supply voltage F)

Dumm from a	Frame			Dimensions														
Pump type s	size	P2 [kW]	A1	A2	A3	A4	Н	H1	H2	H3	B1	B2	D1	D2	L1	L2	L3	L4
CMV 5-2	71A	0.46	Rp 1	Rp 1 1/4	Rp 3/8	14.0	326.7	50	125.0	75.0	126.0	95.0	142.0	109.0	191.0	160.0	65.0	73.5
CMV 5-3	71B	0.65	Rp 1	Rp 1 1/4	Rp 3/8	14.0	344.8	50	143.1	93.1	126.0	95.0	142.0	109.0	191.0	160.0	65.0	73.5
CMV 5-4	80A	0.84	Rp 1	Rp 1 1/4	Rp 3/8	14.0	402.9	50	161.2	111.2	126.0	95.0	142.0	109.0	191.0	160.0	65.0	73.5
CMV 5-5	80B	1.20	Rp 1	Rp 1 1/4	Rp 3/8	14.0	441.0	50	179.3	129.3	126.0	95.0	142.0	109.0	191.0	160.0	65.0	73.5
CMV 5-6	80B	1.20	Rp 1	Rp 1 1/4	Rp 3/8	14.0	459.1	50	197.4	147.4	126.0	95.0	142.0	109.0	191.0	160.0	65.0	73.5
CMV 5-7	90SA	1.58	Rp 1	Rp 1 1/4	Rp 3/8	14.0	508.8	50	202.2	152.2	126.0	95.0	178.0	110.0	191.0	160.0	65.0	111.0
CMV 5-8	90SA	1.58	Rp 1	Rp 1 1/4	Rp 3/8	14.0	526.9	50	220.3	170.3	126.0	95.0	178.0	110.0	191.0	160.0	65.0	111.0
CMV 5-9	90SB	2.20	Rp 1	Rp 1 1/4	Rp 3/8	14.0	585.0	50	238.4	188.4	126.0	95.0	178.0	110.0	191.0	160.0	65.0	111.0
CMV 5-10	90SB	2.20	Rp 1	Rp 1 1/4	Rp 3/8	14.0	603.1	50	256.5	206.5	126.0	95.0	178.0	110.0	191.0	160.0	65.0	111.0

1

TM05 0851 1611

Weights and shipping volumes

# 18. Weights and shipping volumes

All weights and volumes refer to CMV pumps with standard pipe connections.

# CMV 3

Supply voltage	Pump type	Net weight [kg]	Gross weight [kg]	Shipping volume [m <sup>3</sup> ]
	CMV 3-2	12.3	14.8	0.03
	CMV 3-3	13.3	15.8	0.03
	CMV 3-4	13.6	16.1	0.03
	CMV 3-5	13.8	16.3	0.03
1 x 220-240 V, 50 Hz (supply voltage C)	CMV 3-6	15.5	18.0	0.03
	CMV 3-7	16.9	19.4	0.03
	CMV 3-8	17.1	19.6	0.03
	CMV 3-9	23.3	25.8	0.04
	CMV 3-10	27.9	30.4	0.04
	CMV 3-2	12.3	14.8	0.03
	CMV 3-3	12.6	15.1	0.03
	CMV 3-4	12.9	15.4	0.03
	CMV 3-5	13.8	16.3	0.03
3 x 220-240 V / 380-415 V, 50 Hz (supply voltage F)	CMV 3-6	14.1	16.6	0.03
	CMV 3-7	18.0	20.5	0.03
	CMV 3-8	18.3	20.8	0.03
	CMV 3-9	19.3	21.8	0.03
	CMV 3-10	19.3	21.8	0.03

# CMV 5

Supply voltage	Pump type	Net weight [kg]	Gross weight [kg]	Shipping volume [m <sup>3</sup> ]
	CMV 5-2	12.9	15.4	0.03
	CMV 5-3	13.2	15.7	0.03
	CMV 5-4	17.9	17.4	0.03
	CMV 5-5	16.2	18.7	0.03
1 x 220-240 V, 50 Hz (supply voltage C)	CMV 5-6	23.9	26.4	0.04
	CMV 5-7	24.1	26.6	0.04
	CMV 5-8	24.4	26.9	0.04
	CMV 5-9	26.2	28.7	0.04
	CMV 5-10	26.8	29.30	0.04
	CMV 5-2	12.2	14.70	0.03
	CMV 5-3	13.2	15.7	0.03
	CMV 5-4	17.1	19.6	0.03
	CMV 5-5	17.4	19.9	0.03
3 x 220-240 V / 380-415 V, 50 Hz (supply voltage F)	CMV 5-6	17.7	20.2	0.03
	CMV 5-7	24.1	26.6	0.04
	CMV 5-8	24.4	26.9	0.04
	CMV 5-9	28.9	31.4	0.04
	CMV 5-10	29.5	32.0	0.04

Motor data

# 19. Motor data

# Mains-operated motors, 50 Hz

# 1 x 220-240 V, 50 Hz (supply voltage C)

Frame size	P2 [kW]	I <sub>1/1</sub> [A]	Cos φ <sub>1/1</sub>	l <sub>start</sub> [A]	Speed [min⁻¹]
71B	0.5	3.1 - 2.8	0.97 - 0.99	16 - 15	2730 - 2740
80A	0.7	4.4 - 4.0	0.99 - 0.99	17 - 16	2720 - 2800
80B	0.9	5.4 - 5.0	0.98 - 0.98	23 - 22	2750 - 2790
90SA	1.3	8.4 - 8.0	0.98 - 0.98	29 - 27	2710 - 2710
90SB	1.9	11.0 - 10.0	0.99 - 0.98	41 - 37	2755 - 2770

# 3 x 220-240 V / 380-415 V, 50 Hz (supply voltage F)

Frame size	P2 [kW]	l <sub>1/1</sub> [A]	Cos φ <sub>1/1</sub>	l <sub>start</sub> [A]	Speed [min <sup>-1</sup> ]
71A	0.5	2.0 -2.2 / 1.0 - 1.2	0.83 - 0.75	10 - 12 / 5 - 6	2770 - 2820
71B	0.7	2.8 -3.1 / 1.6 - 1.8	0.82 - 0.82	16 - 19 / 9 - 11	2770 - 2820
80BA	0.9	3.5 - 3.8 / 2.0 - 2.2	0.77 - 0.68	21 - 25 / 12 - 14	2840 - 2870
80C	1.2	4.8 - 5.2 / 2.8 - 3.0	0.79 - 0.70	39 - 42 / 22 - 24	2820 - 2860
90SB	1.6	5.6 - 5.4 / 3.3 - 3.0	0.88 - 0.84	46 - 44 / 27 - 25	2880 - 2910
90SC	2.2	8.2 - 8.5 / 4.7 - 4.9	0.83 - 0.75	68 - 73 / 39 - 42	2900 - 2920

# 20. Customisation

Although the Grundfos CMV product range offers a number of pumps for different applications, customers require specific pump solutions. Below are the options available for customising the CMV pumps.

Contact Grundfos for further information or for requests other than the ones mentioned below.

# Motors

## Motor with multi-plug connection

Mains-operated motors fitted with a Harting<sup>®</sup> 10-pin multi-plug connection, HAN 10 ES, enable easy connection to the mains.

The purpose of a multi-plug connection is to facilitate the electrical installation and service of the pump. The multi-plug functions as a plug-and-pump device.



FM02 0470 0700

Fig. 22 Multi-plug logo

Plug connections




Fig. 23 Plug connection from motor




Fig. 24 Plug connection for star connection




Fig. 25 Plug connection for delta connection

**Note:** Wire bridges for connections are located in the plug.

# Motor with anti-condensation heater



20

Customisation

Fig. 26 Mains-operated motor with anti-condensation heater


In applications where condensation in the motor may occur, we recommend to install a motor with an anti-condensation heater on the stator coil ends. The heater keeps the motor temperature higher than the ambient temperature and prevents condensation. High humidity may cause condensation in the motor. Slow condensation occurs as a result of a decreasing ambient temperature; rapid condensation occurs as a result of shock cooling caused by direct sunlight followed by rain.

In areas with ambient temperatures below 0 °C, it is advisable always to use motors with anti-condensation heater.

**Note:** Rapid condensation is not to be confused with the phenomenon which occurs when the pressure inside the motor is lower than the atmospheric pressure. In such cases, moisture is sucked from the atmosphere into the motor through bearings, housings, etc.

In applications with constant humidity levels above 85 %, the drain holes in the drive-end flange must be open. This changes the enclosure class to IP34. If IP55 protection is required due to operation in dusty environments, it is advisable to install a motor with anti-condensation heater.

Figure 27 shows a typical circuit of a three-phase motor with anti-condensation heater.



FM03 4058 1406

Fig. 27 Three-phase motor with anti-condensation heater

#### Legend

Symbol	Designation
К	Contactor
М	Motor
IVI	Motor

**Note:** Connect the anti-condensation heater to the power supply so that it is on when the motor is switched off.

The following motor sizes are available with anti-condensation heater:

Motors, 50/60 Hz	Power of	f heating unit [W]
Frame size	1 x 24 V	1 x 190-250 V
71/80		23
90	38	31
100		38
112/132	2 x 38	2 x 38

#### Motors with PTC sensors



TM02 7038 2403

Fig. 28 PTC sensor incorporated in windings

Built-in PTC sensors (thermistors) protect the motor against rapid as well as slow overheating.

We offer built-in PTC sensors to protect the motor.

Mains-operated three-phase motors with supply voltages C and F of 3 kW and up have PTC sensors as standard (UL-approved motors have no internal protection).

**Note:** PTC sensors must be connected to an external tripping unit.

Protection according to IEC 60034-11:

• TP 211 (slow and rapid overheating).

PTC sensors comply with DIN 44082. Maximum voltage at the terminals,  $U_{max.}$  = 2.5 VDC. All tripping units available for DIN 44082 PTC sensors meet this requirement.

Figure 29 shows a typical circuit of a three-phase motor with PTC sensors.

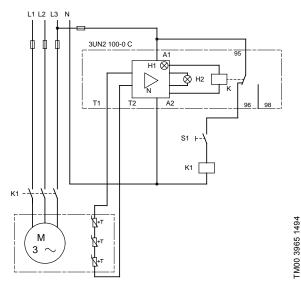


Fig. 29 Three-phase motor with PTC sensors

## Legend

Symbol	Designation
S1	On/off switch
K1	Contactor
+T	PTC sensor (thermistor) in motor
М	Motor
3UN2 100-0 C	Tripping unit with automatic resetting
N	Amplifier
К	Output relay
H1	LED 'Ready'
H2	LED 'Tripped'
A1, A2	Connection for control voltage
T1, T2	Connection for PTC sensor loop

## Motors with thermal switches



Fig. 30 Thermal switch incorporated in windings

Built-in thermal switches protect the motor against rapid as well as slow overheating.

We offer mains-operated motors with bimetallic thermal switches in the motor windings.

Mains-operated three-phase motors with supply voltages C and F are available with built-in thermal switches.

**Note:** Thermal switches must be connected to an external control circuit to protect the motor against slow overheating. The thermal switches require no tripping unit.

Protection according to IEC 60034-11:

• TP 211 (slow and rapid overheating).

As protection against seizure, the motor must be connected to a motor-protective circuit breaker.

Thermal switches tolerate the following maximum loads:

U <sub>max.</sub>	250 VAC
I <sub>N</sub>	1.5 A
I <sub>max.</sub>	5.0 A (locked-rotor and breaking current)

Figure 31 shows a typical circuit of a three-phase motor with built-in bimetallic thermal switches.

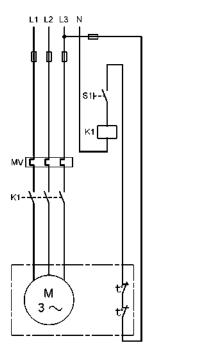


Fig. 31 Three-phase motor with thermal switches

#### Legend

FM02 7042 2403

Symbol	Designation
S1	On/off switch
K1	Contactor
t°	Thermal switch in motor
Μ	Motor
MV	Motor-protective circuit breaker

TM00 3964 1494

20

# Undersize and oversize motors

The available motor sizes are shown in 19. Motor data on page 32.

Undersize and oversize motors are defined as the next kW size below or above the fitted standard motor.

Note: The CMV pumps cannot be combined with frame sizes 112 and 132.

It is advisable to use an oversize motor if the operating conditions fall outside the standard conditions.

We especially recommend oversize motors in these cases:

- The pump is installed at an altitude of more than 1000 metres above sea level.
- The viscosity or density of the pumped liquid is higher than that of water.
- The ambient temperature exceeds +55 °C.

It is advisable to use an undersize motor if the operating conditions do not at all reach the standard conditions.

We especially recommend undersize motors in these cases:

- The viscosity or density of the pumped liquid is lower than that of water.
- The duty point of the pump is constant, and the flow rate is significantly lower than the recommended maximum flow rate.

# Pumps

### Surface treatment

### Cleaned and dried pumps

Cleaned and dried pumps are recommended for use in applications involving strict demands on cleanliness and surface quality, such as low content of silicone. Prior to assembly, all pump parts are cleaned in 60 to 70 °C water with a cleaning agent. All pump parts are then thoroughly rinsed in de-ionised water and air-dried. The pump is assembled without any use of silicone lubricants.

Cleaned and dried pumps are not performance-tested.

#### Alternative colouring

We offer custom-built pumps in any NCS- or RAL-specified colour to suit your requirements.

The used paint is water-based. Painted parts correspond to corrosion class III.

All pump types and sizes are available with alternative colouring.

## Customised nameplate

We offer additional customised nameplates attached to the pump:

- · A nameplate supplied by you.
- A Grundfos nameplate customised in terms of a specific duty point.
- A Grundfos nameplate with a tag number.

**Note:** The Grundfos standard nameplate is always fitted to the pump.

## Shaft seal arrangements

The shaft seal is developed with customisation in mind. Depending on media, you may combine the seal faces in any way.

Available stationary seal faces: Q, B.

Available rotating seal faces: Q, V.

Rubber: E and V.

Note: For further details about seal face material codes, see Type key on page 8.

## Alternative connection positions

The pump is available with various connection positions on special request.

## Alternative pipe connections

A wide range of pipe connections are available for the CMV pumps:

- Tri-Clamp<sup>®</sup>
- DIN, JIS, ANSI flange
- PJE coupling (Victaulic<sup>®</sup>)
- Whitworth thread Rp
- · internal NPT thread.



Fig. 32 Pipe connections

36



GRUNDFOS

# 21. Accessories


# **Pipework connections**

Various sets of flanges and couplings are available for pipework connection.

# Distance piece

The distance piece is intended for mounting on the discharge port in order to improve the accessibility when connecting the pump to the piping system.

The distance piece is made of brass.

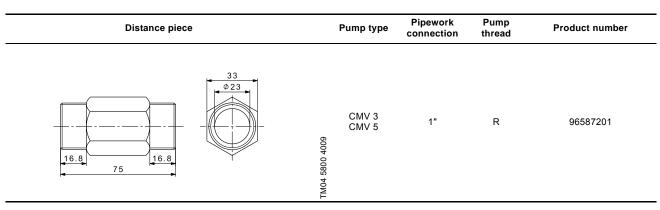

# Flange sets for CMV (DIN/ANSI/JIS)

All materials in contact with the pumped liquid are made of stainless steel, EN 1.4408/AISI 316.

			Pipework Pu		2umpL* [mm]			
Flange		Pump type	connection	thread	Flange fitted to pump inlet	Flange fitted to pump outlet	Product number	
Π				Rp			96904693	
		CMV 3	DN 32	NPT	- 49.0	78.0	96904705	
└┘ ╸└╴╸	085 0105	367 0:	DIN 32	Rp			96904696	
	Φ140 ····	86 VMC 5		NPT	-		96904708	

\* Length from outer edge of flange to pump suction or discharge port.

# **Counter flanges for CMV**

Counter flanges for CMV pumps are made of cast iron, EN-GJL-200.

A counter-flange set consists of one counter flange, one gasket, bolts and nuts.

Counter flange		Pump type	Description	Rated pressure	Pipework connection	Product number
	3705	CMV 3-A	Threaded	16 bar, EN 1092-2	Rp 1 1/4	00419901
<u>- 078</u> <u>- 0100</u> - 0140	TM03 0400 (	CMV 5-A	For welding	25 bar, EN 1092-2	32 mm, nominal	00419902

21

Accessories

# PJE/Victaulic<sup>®</sup> connections for CMV

PJE connection	F	Pump type	Pump thread	D [mm]	L <sup>*</sup> [mm]	Product number
	90	CMV 3	Rp	33.7	48.5	96904694
	5 0309		NPT	55.7	40.5	96904706
	4 386	CMV 5	Rp	33.7/42.4	48.5	96904697
	TMO		NPT	33.7742.4	40.5	96904709

Length from outer edge of PJE connection to pump suction or discharge port.

### Coupling, pipe stub and gasket for PJE connections

Parts in contact with the pumped liquid are made of stainless steel, EN 1.4401/AISI 316, and rubber.


A PJE coupling set consists of two coupling halves (Victaulic<sup>®</sup>, type 77), one gasket, one pipe stub (for welding or threaded), bolts and nuts.

Coupling a	and pipe stub		Pump type	Pipe stub	Pipework connection	Rubber parts	Number of coupling sets required	Product number
			CMV 3 CMV 5*	Threaded	R 1 -	EPDM	2	97575245
						FKM	2	97575246
2	<u></u>			For welding	DN 25	EPDM	2	97575247
	1 Alexandre					FKM	2	97575248
	M.	4		Threaded	R 1 1/4	EPDM	1	00419911
		8 1094	ON1) / 5**	Inreaded		FKM	1	00419905
Ŧ	Ŧ	3808	CMV 5**	For welding DN 32		EPDM	1	00419912
		TM00			DN 32	FKM	1	00419904

For discharge port. **Note:** Only one coupling set is required for the discharge port.

\*\* For suction port.

# Tri-Clamp<sup>®</sup> connections for CMV

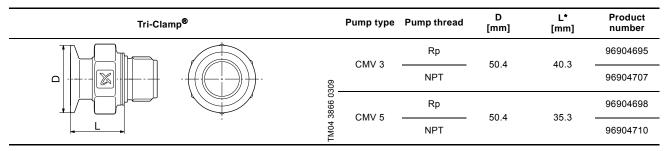

\* Length from outer edge of Tri-Clamp<sup>®</sup> connection to pump suction or discharge port.

Accessories

# Clamping ring, pipe stub and gasket for $\mathsf{Tri-Clamp}^{\texttt{®}}$ connections

		Clamping ring				Pipe stub			Gasket			
				TM03 4645 2406					TM03 4646 2406	<b>A</b>		TM03 4647 2406
Pump type	Nominal diameter [mm]	A [mm]	B [mm]		A [mm]	B [mm]	C [mm]	D [mm]		A [mm]	B [mm]	
CMV 3, 5	38.0	92.0	59.5		21.5	50.5	35.6	38.6		35.3	50.5	

The clamping ring is made of stainless steel, EN 1.4301/AISI 304.

The pipe stub is made of stainless steel, EN 1.4401/AISI 316.

The gasket is made of PTFE or EPDM.

Pump type	Pipework connection	Connection material	Gasket	Pressure [bar]	Number of coupling sets required	Product number
CMV 3. 5	DN 32	Stainless steel	EPDM	- 16	2	96515374
CIVI V 3, 5	DIN 52	Stanness steel	PTFE	- 10	2	96515375

# MP 204 motor protector



## Fig. 33 MP 204

The MP 204 is an electronic motor protector and data collecting unit. Apart from protecting the motor, it can also send information to a control unit via GENIbus, like for instance:

- trip
- warning
- energy consumption
- input power
- motor temperature.

The MP 204 protects the motor primarily by measuring the motor current by means of a true RMS measurement.

The pump is protected secondarily by measuring the temperature with a Tempcon sensor, a Pt100/Pt1000 sensor and a PTC sensor/thermal switch.

The MP 204 is designed for single- and three-phase motors.

**Note:** The MP 204 must not be used together with frequency converters.

### Features

- Phase-sequence monitoring
- indication of current or temperature
- input for PTC sensor/thermal switch
- indication of temperature in °C or °F
- 4-digit, 7-segment display
- setting and status reading with the Grundfos R100 remote control
- setting and status reading via the Grundfos GENIbus fieldbus.

## **Tripping conditions**

- Overload
- underload (dry running)
- temperature
- missing phase
- phase sequence
- overvoltage
- undervoltage
- power factor (cos φ)
- current unbalance.

## Warnings

FM03 1471 2205

- Overload
- underload
- temperature
- overvoltage
- undervoltage
- power factor (cos φ)
- run capacitor (single-phase operation)
- starting capacitor (single-phase operation)
- loss of communication in network
- harmonic distortion.

## Learning function

- Phase sequence (three-phase operation)
- run capacitor (single-phase operation)
- starting capacitor (single-phase operation)
- identification and measurement of Pt100/Pt1000 sensor circuit.

#### Product number

Description	Product number
MP 204 motor protector	96079927

# **Cover for CMV motor**

The cover protects the motor from ingress of liquid, especially if the pump is installed in a vertically tilted position with the motor end pointing upwards.

#### Product number

Description	Product number
Cover for CMV motors, frame sizes 71 and 80	97528743

# Angled cable gland




Fig. 34 Angled cable gland with O-ring and lock nut

Description	Product number
Angled cable gland with O-ring and lock nut	97842998

22

# 22. Further product documentation


# WebCAPS

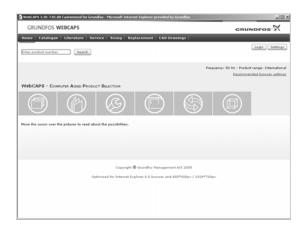


WebCAPS is a **Web**-based **C**omputer **A**ided **P**roduct **S**election program available on www.grundfos.com. WebCAPS contains detailed information on more than 220,000 Grundfos products in more than 30 languages.

Information in WebCAPS is divided into six sections:

- Catalogue
- Literature
- Service
- Sizing
- Replacement
- · CAD drawings.

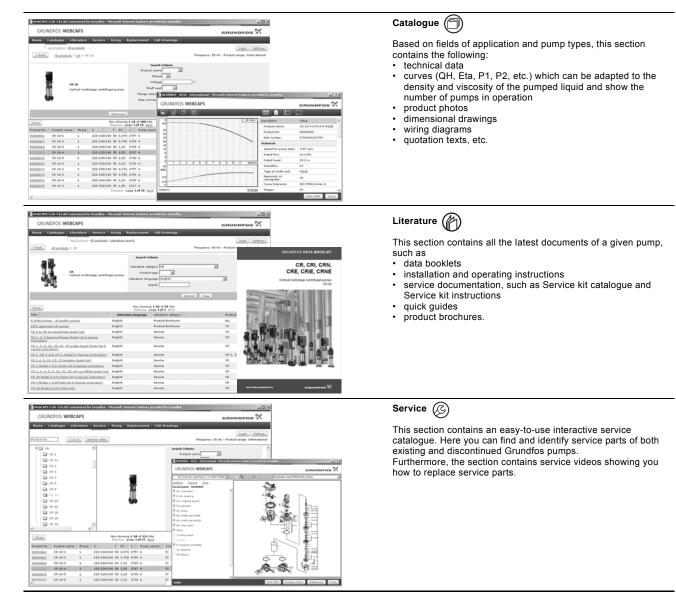

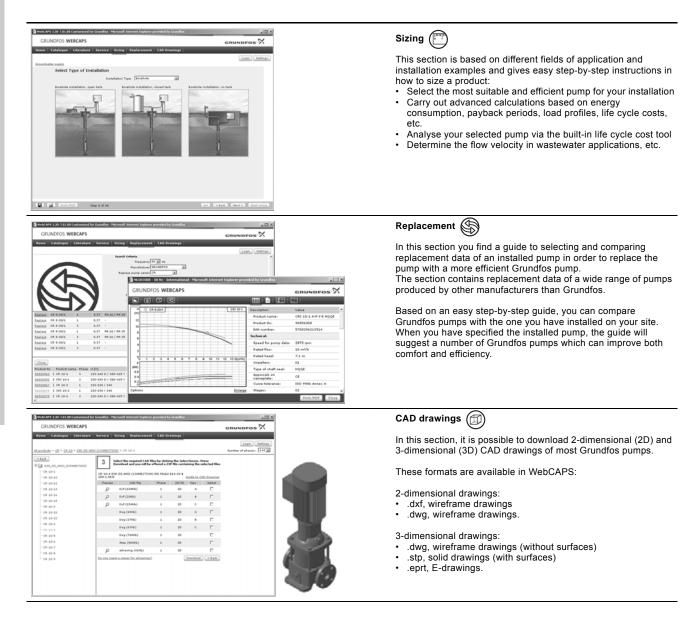

# **WinCAPS**



Fig. 35 WinCAPS CD-ROM

#### WinCAPS is a **Win**dows-based **C**omputer **A**ided **P**roduct **S**election program containing detailed information on more than 220,000 Grundfos products in more than 30 languages.

The program contains the same features and functions as WebCAPS, but is an ideal solution if no internet connection is available.

WinCAPS is available on CD-ROM and updated once a year.

Subject to alterations.

22



97942071 0611 Repl. 97942071 0511 ECM: 1076991

The name Grundfos, the Grundfos logo, and the payoff Be–Think–Innovate are registrated trademarks owned by Grundfos Management A/S or Grundfos A/S, Denmark. All rights reserved worldwide.



**GRUNDFOS A/S** . DK-8850 Bjerringbro . Denmark Telephone: +45 87 50 14 00 www.grundfos.com